

INSTAPLAST

pipelife.com

PP-R/PP-RCT



System for distribution of potable, cold and hot water.
Can be used for the distribution of compressed air.

PIPELIFE 
always part of your life

CONTENT

1.	PP-R/PP-RCT system INSTAPLAST	4
1.1.	Advantages of the system	4
1.2.	Pipes	4
1.2.1.	Pipes from PP-R	4
1.2.2.	Pipes from PP-RCT	4
1.2.3.	Overview of pipes	5
1.3.	Fittings	6
1.4.	Operating conditions according to ISO 10508	6
1.5.	Pipe dimensions for water distribution acc. to standard EN ISO 15874	6
1.6.	Material of the system	7
1.7.	Chemical resistance	8
1.8..	System disinfection	8
1.9.	Lifetime	8
1.10.	Economical aspects of use of the plastic pipes, generally	8
1.11.	Ecology - waste	8
1.12.	Usage for the other media	8
1.13.	Certification	8
1.14.	Table of interdependency of temperature, pressure and durability for individual Types of pipes	9
2.	Storage and handling, guarantee conditions	10
2.1.	Storage and handling	10
2.2.	Guarantee conditions of PP-R/PP-RCT system INSTAPLAST	10
3.	Design and dimensioning plastic pipes	11
4.	Fire water pipeline	11
5.	Pressure losses	12
5.1.	Pressure loss calculation	12
5.2.	Pressure loss in fitting (connecting fitting)	12
5.3.	Tables of pressure losses	13
6.	Distribution systems of drinking water, cold and hot water	26
6.1.	Piping mains	26
6.2.	Distance of supports	28
7.	Compensation of plastic piping	29
8.	AsseSPly and repairs of the system	31
8.1.	Piping connection	31
8.2.	Weldability of materials	31
8.3.	Polyfusion welding	31
8.4.	Piping repairs	34
8.5.	Additional installation of the weld in saddle	34
8.6.	Welding by electro-forming	34
8.7.	Working conditions	34
9.	Pressure test	35
10.	Connection of the internal water supply and the electrical protective conductor device	36
11.	Insulation of piping	37
12.	Products	38

1. PP-R/PP-RCT SYSTEM INSTAPLAST

1.1. ADVANTAGES OF THE SYSTEM

- Wide range of pipes for different applications
- Wide range of fittings in the pressure range of S2,5
- Substitution of steel pipes by plastic ones results in considerably positive ecological and economical indicators
- Minimal service life in case of correct application: 50 years
- Hygienically harmless, it is not susceptible to corrosion
- Installation is simple, clean and quick
- Easy handling due to low weight
- Low noisiness
- The system complies with the standards for classification as "Environment friendly product"

1.2. PIPES


1.2.1. PIPES FROM PP-R

PP-R S5 / S3,2 / S2,5

Pipes from the standard PP-R.

Permissible pressure load depends on the wall thickness. Former pressure range classification according to EN ISO 15874 moves from PN to the S (series) range.

$$\text{Marking } S = \frac{d - s}{2s} = \frac{\text{SDR} - 1}{2}$$



1.2.2. PIPES FROM PP-RCT

UNIBETA

UNIBETA pipes are all plastic pipes from innovative material PP-RCT. Special process of nucleation improves the crystalline structure of random copolymer PP-R. Through this process, the material gains far better pressure and temperature characteristics.

CARBO^{CRP}

CARBO^{CRP} are three-layer pipes, **wherein the outer and inner layer are made of PP-RCT. The middle layer contains compound of carbon fiber (CF).**

Advantages of CARBO^{CRP} pipes

- Temperature resistant up to 90 °C
- Higher pressure resistance at high temperatures of up to 50 %
- Higher flow up to 20 %
- Even smaller thermal linear expansion
- No need to peel before welding



CARBO oxy^{CRP}

The highest range of pipes from PP-R/PP-RCT system INSTAPLAST. The construction of the pipe is three-layer. The outer and inner layers are made of PP-RCT. The middle layer contains a carbon compound (CF) and special additives (SA). This middle layer forms oxygen barrier - prevents entering of oxygen from the environment through the wall of the pipe to the heat transfer/cooling medium. This protects the sensitive parts in a closed circuit (boiler, exchanger, pump) against corrosion.

You will find this pipe and suitable use, as well as technical documents and installation instructions, in the separate PP-RCT catalog INSTAPLAST system for heating and cooling circuits.

1.2.3. OVERVIEW OF PIPES

TYPES OF PIPES AND THEIR USE

	Pipe Type	Scope of application					
		Cold water	Hot water	Heating I (max. 70 °C)	Heating II (max. 90 °C)	Air	Cooling
	PP-R S5	■					
	PP-R S3,2	■	■				■
	PP-R S2,5	■	■	■		■	■
	UNIBETA	■	■	■		■	■
	UNIBETAPLUS	■	■	■		■	■
	CARBO ^{CRP}	■	■	■	■	■	■
	CARBO oxy ^{CRP} HEAT/COOL	■	■	■	■	■	■
	CARBO oxy ^{CRP} HEAT	■	■	■	■	■	■
	CARBO oxy ^{CRP} COOL	■				■	■

TYPES OF PIPES – BASIC CHARACTERISTICS

Pipe Type	More information						
	Pressure range Dimension range	Material	Pressure resistance according to class 2 (hot water 70 °C)	Pressure resistance according to class 5 (heating water 90 °C)	Coefficient of thermal linear expansion	Lifetime	Guarantee
PP-R S5	S5 (PN10) Ø 20 - 40	PP-R	-	-	0,150 mm/(m.K)	50 years	10 years
PP-R S3,2	S3,2 (PN16) Ø 20 - 40	PP-R	6 bar	-	0,150 mm/(m.K)	50 years	10 years
PP-R S2,5	S2,5 (PN20) Ø 20 - 40	PP-R	8 bar	6 bar	0,150 mm/(m.K)	50 years	10 years
UNIBETA	S3,2 Ø 16 S4 Ø 20 - 125 S5 Ø 160 - 200	PP-RCT	8 bar	6 bar	0,150 mm/(m.K)	50 years	10 years
UNIBETAPLUS	S3,2 Ø 20-32	PP-RCT	10 bar	8 bar	0,150 mm/(m.K)	50 years	10 years
CARBO ^{CRP}	S3,2 Ø 20 - 63 S4 Ø 75 - 125	PP-RCT/PP-RCT+CF/ PP-RCT	10 bar	8 bar	0,045 mm/(m.K)	50 years	10 years
CARBO oxy ^{CRP} HEAT/COOL	S3,2 Ø 20 - 32	PP-RCT/PP-RCT+ CF+SA/PP-RCT	10 bar	8 bar	0,045 mm/(m.K)	50 years	10 years
CARBO oxy ^{CRP} HEAT	S4 Ø 40 - 125	PP-RCT/PP-RCT+ CF+SA/PP-RCT	10 bar	8 bar	0,045 mm/(m.K)	50 years	10 years
CARBO oxy ^{CRP} COOL	S5 Ø 40 - 125	PP-RCT/PP-RCT+ CF+SA/PP-RCT	-	-	0,045 mm/(m.K)	50 years	10 years

1.3. FITTINGS


The fittings correspond to the dimension ranges of pipes. They are produced in the highest pressure range S 2.5 (PN 20) and therefore are suitable for all piping of PP-R/PP-RCT system INSTAPLAST.

Plastic fittings differ from each other depending on the application and function in the system. They may be simply divided to:

- Full plastic fittings which forms the basis of the system (T-pieces, elbows, pipe couplings, reductions, blinders, plugs etc.)
- CoSPined fittings for connecting threaded parts of pipes, fittings (DG transitions with metal plugs or with coSPined threads, bulkheads, flanged collars, etc.)
- Plastic shut-off valves - direct and, ball valves
- Additional elements (clips, crossings, dilatation loops)


DG-coupling MZV

Coupling with external brass thread. The brass thread is full nickel plated, new technology with internal transit injected with plastic material - possible to use for distribution of cold and hot water. There are manufactured also as elbows and T-pieces MZV.



DG-coupling MZD

Coupling with internal brass nickel plated thread, possible to use for cold and hot water distribution. There are manufactured also as elbows and T-pieces MZD or wall-mounted pieces.



1.4. OPERATING CONDITIONS ACCORDING TO ISO 10508

Class of use and maximal operating pressures are printed on each pipe.

Class	Lifetime	Service life	Operating temperature [°C]	Application	PP-R		PP-RCT		
					S2,5 (PN20) SDR 6	S3,2 (PN16) SDR 7,4	S3,2 SDR 7,4	S4 SDR 9	S5 SDR 11
					Maximal operating pressure [bar]				
1	50 years	49 years	60	hot water 60 °C	10	8	10	8	6
		1 year	80						
	Tmal/service life Tmal	100 hours	95						
2	50 years	49 years	70	hot water 70 °C	8	6	10	8	6
		1 year	80						
	Tmal/service life Tmal	100 hours	95						
4	50 years	2,5 years	20	underfloor heating low temperature radiators	10	10	10	8	6
		20 years	40						
		25 years	60						
		2,5 years	70						
	Tmal/service life Tmal	100 hours	100						
5	50 years	14 years	20	high temperature radiators	6	-	8	6	-
		25 years	60						
		10 years	80						
		1 year	90						
	Tmal/service life Tmal	100 hours	100						

1.5. PIPE DIMENSIONS FOR WATER DISTRIBUTION ACC. TO STANDARD EN ISO 15874

Dimension [mm]	Wall thickness of the pipe [mm]*						
	PP-R			UNIBETA	CARBO ^{CRP}	CARBO oxy ^{CRP} HEAT	CARBO oxy ^{CRP} COOL
	S5 (PN10)	S3,2 (PN16)	S2,5 (PN20)	S3,2/S4/S5*	S3,2/S4*	S3,2/S4	S3,2/S5
16	-	-	-	2,2	-	-	-
20	1,9	2,8	3,4	2,3	2,8	2,8	
25	2,3	3,5	4,2	2,8	3,5	3,4	
32	2,9	4,4	5,4	3,6	4,4	4,4	
40	3,7	5,5	6,7	4,5	5,5	4,5	3,7
50	4,6	6,9	8,3	5,6	6,9	5,6	4,6
63	5,8	8,6	10,5	7,1	8,6	7,1	5,8
75	6,8	10,3	12,5	8,4	8,4	8,4	6,8
90	8,2	12,3	15,0	10,1	10,1	10,1	8,2
110	10,0	15,1	18,3	12,3	12,3	12,3	10,0
125	-	-	-	14,0	14,0	14,0	11,4
160	-	-	-	14,6	-	-	-
200	-	-	-	18,2	-	-	-

Note: In water at temperature of 30 °C - 50 °C, there is a proliferation of bacteria, incl. type Legionella. Owing to this fact, we recommend to perform regularly a short-term overheating of hot water tanks from 60 °C up to 70 °C. Therefore exceptionally the pipes of S2,5 pressure range (PN20), UNIBETA, CARBO^{CRP} or CARBO oxy^{CRP} should be used.

1.6. MATERIAL OF THE SYSTEM

We use **PP-R** (PP-polypropylene type 3 random, gray) and **PP-RCT** material for the production of INSTAPLAST. It gets a much better **pressure and temperature properties** due to a special process of nucleation, which improves the crystalline structure of random copolymer PP-R.

System PP-R/PP-RCT system INSTAPLAST is manufactured according to the standard EN ISO 15874.

Material properties		PP-R	PP-RCT
Density [kg/m³]		900-910	905
The melt flow index MFI 230 / 2.16 [g/10 min]		0,30	0,30
Notched impact strength (Charpy) [kJ/m²]	23 °C	31	40
	-20 °C	2,2	2,0
Shear modulus [N/mm²]		400	-
Tensile modulus [N/mm²]		900	900
Elongation at yield [%]		12	100
Tensibility [%]		200	-
Yield strength [N/mm²]		26	25
Absorbency [%/7 days]		0,03	-
Coefficient of thermal linear expansion [mm/(m.K)]		0,15	0,15
Coefficient of thermal conductivity W/(m.K)		0,24	0,24

1.7. CHEMICAL RESISTANCE

Pipes and fittings made of PP-R and PP-RCT are suitable for transporting all substances to it do not violate. It resists the action of radon. It is not resistant to long-term operation of a number of some concentrated petroleum products. Transported the medium may have a pH in the range of 2 to 12, i.e. water may show both acidic and basic reactions. The pipes can be used for a wide range of reaction fluids in various industries, they are not recommended for the transport of oxidizing media or for long-term use of pipelines for the transport of disinfectant solutions.

To determine the suitability for the transport of chemicals other than water, we have a separate brochure - **Chemical resistance of plastic materials**.

When transporting media other than water, it must be remembered that the service life of the pipeline here can decrease much more significantly with increasing temperature.

1.8. SYSTEM DESINFECTION

Thermal disinfection of the system

In the case of thermal disinfection to prevent legionella bacteria, we recommend disinfecting with a duration of min. 3 minutes and water at 70 °C throughout the system.

Chemical disinfection of the system

Disinfection of the system must be applied only in case of proven contamination. In the case of impact disinfection, it is permitted to load plastic pipes twice a year with a free chlorine content of 50 mg/l for a period not exceeding 12 hours. Alternatively, 150 mg/l hydrogen peroxide (H_2O_2) can be used for 24 hours. The temperature must not exceed 30 °C during the disinfection process. The use of a disinfection process, especially for chlorinated water, can have a direct impact on the life of the drinking water system.

1.9. LIFETIME

Molecular structure of plastic material, if it is exposed to permanent influence of tension, shows a slow flow of polymer chains and at the same time their orientation is changed. The first consequence of this effect is that Young's modulus for calculation differs in compliance with the assumed loading time. For a longer time of operation, it is lower than for a short-time operation – also the data result from this fact, as given in the below table of temperature dependability. These are the values taken during long-term laboratory tests which have been already verified by practical use and also are published in EN and ISO standards. Second consequence of the orientation polymer chains is called relaxation. After the mechanical loading (pressure tension etc.), a strain is developed in the pipe walls. If the force is not effecting permanently, the strain in pipe walls will decrease after some time (is relaxed) to zero, and the pipe behaves then as if it was without any loading. Its strength does not decrease and the pipe „does not grow old“.

The thickness of the pipe walls are determined so, that their strength at the end of the planned lifetime, and during the permanent operation at max. nominal pressure at 20 °C, reached the value which is necessary for the reliable function of the pressure order at maximum operation pressure, and with the determined safety coefficient (see below). If the pipe is not operated at max. pressure for the whole time, the lifetime is extended – see the table. The assumed lifetime of the system, when the selection of material, pressure range and the application is correct, is 50 years.

1.10. ECONOMICAL ASPECTS OF USE OF THE PLASTIC PIPES, GENERALLY

The usage of the plastic pipes provides to the user many advantages:

- High resistance against creation of incrustation (self-cleaning ability, permanent flow section).
- Flexibility of the pipes provide resistance to damage during the transport and installation.
- There is no risk of attack by microorganisms. Fungi or the corrosion caused by stray currents.
- Low weight, which allows for faster, more accurate and safer work, decreases the cost for transport and storage.

1.11. ECOLOGY – WASTE

All the materials used for packing of products of Pipelife Czech s.r.o. are classified for the „O“ category – other waste. Prisms, boxes, polyethylene foils and raschel bags may be proposed for the use as secondary resources or may be stored or disposed without any problems in incineration plants. Steel binding strips may be used as an iron scrap.

1.12. USAGE FOR THE OTHER MEDIA

For the industrial distribution media or other liquid bulk and gaseous substances it is necessary to consult the use with us as a producer. In must take into account the chemical resistance of the material, physical characteristics and other circumstances of assembly technology.

1.13. CERTIFICATION

Plastic piping systems delivered by company Pipelife Czech s.r.o. are certified by authorized person according to Act No. 22/1997 Coll. about technical requirements to products, in compliance with the last valid regulation of the government of the Czech Republic. The piping for drinking water complies with the hygienic requirements, in compliance with the valid regulation of Ministry of Health of the Czech Republic. The company Pipelife Czech s.r.o. has introduced, documented and certified the Quality Management System acc. to EN ISO 9001 and the Environmental Management System acc. to EN ISO 14001.

All valid documents are published on www.pipelife.cz or will be send upon request (please see the end of this document).

System PP-R/PP-RCT system INSTAPLAST is certified in the following countries: Czech Republic (Czech certificate is valid for all countries of European Union), Russia and Ukraine.

1.14. TABLE OF INTERDEPENDENCY OF TEMPERATURE, PRESSURE AND DURABILITY FOR INDIVIDUAL TYPES OF PIPES

Temperature [°C]	Lifetime [years]	PP-R			PP-RCT	
		S5 (PN10)	S3,2 (PN16)	S2,5 (PN20)	UNIBETA • CARBO ^{CRP}	
					S4	S3,2
10	1	17,5	27,8	35,1	24,0	30,2
	5	16,5	26,2	33,0	23,2	29,3
	10	16,1	25,6	32,2	22,9	28,9
	25	15,6	24,7	31,1	22,5	28,4
	50	15,2	24,1	30,3	22,2	28,0
20	1	15,0	23,7	29,9	20,9	26,3
	5	14,1	22,3	28,1	20,2	25,4
	10	13,7	21,7	27,4	19,9	25,1
	25	13,2	21,0	26,4	19,6	24,6
	50	12,9	20,4	25,7	19,3	24,3
30	1	12,7	20,2	25,4	18,1	22,7
	5	11,9	18,9	23,8	17,4	22,0
	10	11,6	18,4	23,2	17,2	21,7
	25	11,2	17,7	22,3	16,9	21,2
	50	10,9	17,2	21,7	16,6	20,9
40	1	10,8	17,1	21,6	15,5	19,6
	5	10,1	16,0	20,2	15,0	18,9
	10	9,8	15,5	19,6	14,7	18,6
	25	9,4	15,0	18,8	14,4	18,2
	50	9,2	14,5	18,3	14,2	17,9
50	1	9,1	14,5	18,2	13,3	16,7
	5	8,5	13,5	17,0	12,8	16,1
	10	8,2	13,1	16,5	12,6	15,8
	25	7,9	12,6	15,9	12,3	15,5
	50	7,7	12,2	15,4	12,1	15,2
60	1	7,7	12,2	15,4	11,2	14,2
	5	7,1	11,3	14,3	10,8	13,6
	10	6,9	11,0	13,9	10,6	13,4
	25	6,6	10,5	13,3	10,4	13,1
	50	6,4	10,2	12,9	10,2	12,8
70	1	6,5	10,3	12,9	9,4	11,9
	5	6,0	9,5	12,0	9,1	11,4
	10	5,8	9,2	11,6	8,9	11,2
	25	5,0	8,0	10,0	8,7	10,9
	50	4,2	6,7	8,5	8,5	10,7
80	1	5,4	8,6	10,8	7,9	9,9
	5	4,8	7,6	9,6	7,5	9,5
	10	4,0	6,4	8,1	7,4	9,3
	25	3,2	5,1	6,5	7,2	9,1
95	1	3,8	6,1	7,6	5,9	7,4
	5	2,6	4,1	5,2	5,6	7,1

 cold water

 hot water

 hot & cold water

Values in the table for PP-R, UNIBETA and CARBO^{CRP} pipes are determined using the safety coefficient SF = 1.5.

The table clearly shows that higher operating temperatures and operating pressures affect the mechanical properties of the pipeline and thus affect the length of its service life.

2.

STORAGE AND HANDLING, GUARANTEE CONDITIONS

2.1. STORAGE AND HANDLING

The elements of PP-R/PP-RCT system INSTAPLAST are stored in accordance with ČSN 64 0090, from which some important parts are referred to further below together with the detailed conditions of company Pipelife Czech s.r.o.

- The elements of PP-R/PP-RCT system INSTAPLAST must not be stored outdoor.
- They must not be exposed to permanent direct solar radiation and climatic influences.
- They must be placed under a canopy in a dry and dust-free environment
- They must not be stored together with organic solvents, products containing solvents and other chemicals for which the neutrality to the stored material is not assured (petrol, oil, sulphur etc.).
- They should not be exposed to emission of heat, the distance from heat source must be min. 1 meter.
- Temperature in stores must not exceed the value + 40 °C. Piping for drinking water must not be contaminated during storage.
- **Special care must be taken during manipulation at temperature below 0 °C.**
- The elements of PP-R/PP-RCT system INSTAPLAST must be stored separately, acc. to the type of plastic material, pressure range, shape and dimension.
- They must not be permanently unilaterally stressed, bent and leaned against sharp edges during storage and handling.
- The pipes produced in straight bars must be stored in horizontal position, min. 0.1 m above floors and in layers maximum up to 0.6 m.
- Maximal distance of supports for piping dimensions 16 – 32 mm is 0.25 m, for dimensions 40 – 100 mm it is 0.5 m.

- Supports on which the piping is laid must be so designed that it cannot damage the piping (flat supports). Minimal width of supports beams is 0.05 m.
- The pipes produced in the rolls must be stored in horizontal position, min. 0.1 m above the floor, max. 3 rolls in a pile.
- During the manipulation of elements PP-R/PP-RCT system INSTAPLAST, the packing should not be damaged.
- Individual elements should not be slide over floor or rubbed against sharp edges during handling. Strong shocks should be avoided during the manipulation with them.

2.2. GUARANTEE CONDITIONS OF THE SYSTEM

During the assembly, the combinations with elements which are not suitable for the PP-R/PP-RCT system INSTAPLAST is unacceptable. For the assembly of formed pieces with metal injection, it is not allowed to use hemp, but PTFE tape of sealing mastic Siseal or sealing PTFE thread Loctite. Storage of the material must comply with storage conditions as given above in this chapter.

Projecting, assembly and operation must be in compliance with this manual for PP-R/PP-RCT system INSTAPLAST. Assembly of plastic piping may be performed only by a worker who provable possess a valid certificate of welder D – U7, as the minimum, or certificate of welder for plastic materials Z – U/7, Z – U/V and C – U/V.

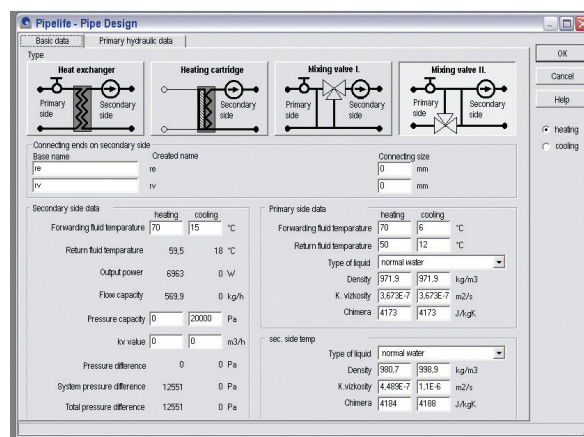
3.

DESIGN AND DIMENSIONING PLASTIC PIPES

Of course there will be specifications of required system components and design documentation. Our calculation program is also available a tour contractual designers. In case of your interest inform the sales managers of our company or directly contact our staff via email:

projekcni.podpora@pipelife.com.

You can use the services of designers who work with SW PROTECH Nový Bor for calculation and design of drinking and hot water. The database of this SW contains In-house products of Pipelife Czech, incl. PP-R/PP-RCT system INSTAPLAST.



4.

FIRE WATER PIPELINE

Polypropylene piping may be used for distribution of flooded fire-protective mains, if the following conditions are met:

- The piping should be laid lose in areas which are not exposed to higher temperature than 70 °C during fire.
- In other cases (in areas, in which the fire-fighting equipment is available) the piping must be placed in an installation shaft or channel with double fire resistance than is required usually for the installation shafts.

- When it is installed through a fire barrier, the transition through the structure must be additionally sealed by a material with the lowest flammability. The sealing structure must have fire-protective resistance as high as is the fire-protective resistance of the structure through which the distribution system passes. However, the resistance is not required there higher than 60 minutes. If the passing piping has the inside cross section up to 8.000 mm², then no further measures are required.

5. PRESSURE LOSSES

5.1. PRESSURE LOSS CALCULATION

Pressure losses in the pipeline Δp_{RF} [kPa] are determined by the following formula:

$$\Delta p_{RF} = \sum_{j=1}^n [l_j \cdot R_j + \Delta p_{Fj}]$$

- l length of the pipe section [m]
- R longitudinal pressure losses due to friction [kPa/m]
- Δp_{Fj} pressure loss due to local resistance in the respective section [kPa]
- n number of pipe sections

Longitudinal pressure losses due to friction R [kPa/m] were determined by the formula:

$$R = \frac{\lambda}{d_i} \cdot \frac{v^2}{2000} \cdot \rho$$

- d_i inner diameter of pipe [m]
- λ friction coefficient [-]
- v water velocity in the pipe [m/s]
- ρ water density [kg/m³] depending on the water temperature T [°C].
 - $\rho = 999,3$ [kg/m³] at $T = 10$ °C
 - $\rho = 987,9$ [kg/m³] at $T = 50$ °C
 - $\rho = 971,8$ [kg/m³] at $T = 80$ °C

The pressure loss due to local resistance (fittings and fixtures) Δp_F [kPa] is determined by:

$$\Delta p_F = \frac{v^2}{2000} \cdot \rho \cdot \sum_{i=1}^m \xi_i$$

- v water velocity in the duct [m/s]
- ρ water density [kg/m³] depending on the water temperature T [°C]
 - $\rho = 999,3$ [kg/m³] at $T = 10$ °C
 - $\rho = 987,9$ [kg/m³] at $T = 50$ °C
 - $\rho = 971,8$ [kg/m³] at $T = 80$ °C
- ξ resistance coefficient

Individual resistance coefficients are determined by the test. It is therefore a purely empirical values which may fluctuate significantly. The values in the table are "proven in practice" to be the best basis for calculation the pressure loss in the piping system.

To calculate the total piping head loss, it is necessary to count with great care all the individual parts. From our experience it is recommended recording various independent components into the table.

5.2. PRESSURE LOSS IN FITTING (CONNECTING FITTING)

Resistance coefficient (depending on geometry)

Pipe coupling	$\xi = 0,2$
Reduction	$\xi = 0,55$
Elbow 90°	$\xi = 1,5$
T-piece	$\xi = 1,1$
T-piece branch	$\xi = 1,5$
Reducing T-piece	$\xi = 1,1$
Reducing T-piece branch	$\xi = 4,3$
Metal - plastic coupling	$\xi = 0,4$
Metal - plastic reducing coupling	$\xi = 8,3$

5.3. TABLES OF PRESSURE LOSSES

PP-R S5 (PN10) PIPES

water temperature = 10 °C

	20 × 1,9 mm		25 × 2,3 mm		32 × 2,9 mm		40 × 3,7 mm	
Q	R	v	R	v	R	v	R	v
l/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s
0,01	0,006	0,1						
0,02	0,020	0,1	0,006	0,1				
0,03	0,041	0,2	0,012	0,1	0,003	0,1		
0,04	0,067	0,2	0,019	0,1	0,006	0,1		
0,05	0,099	0,3	0,029	0,2	0,008	0,1	0,003	0,1
0,06	0,137	0,3	0,039	0,2	0,011	0,1	0,004	0,1
0,07	0,180	0,4	0,052	0,2	0,015	0,1	0,005	0,1
0,08	0,227	0,4	0,065	0,3	0,019	0,2	0,006	0,1
0,09	0,280	0,5	0,080	0,3	0,023	0,2	0,008	0,1
0,10	0,337	0,5	0,097	0,3	0,028	0,2	0,009	0,1
0,12	0,465	0,6	0,133	0,4	0,038	0,2	0,013	0,1
0,14	0,611	0,8	0,175	0,4	0,050	0,3	0,017	0,2
0,16	0,774	0,9	0,222	0,5	0,063	0,3	0,022	0,2
0,18	0,954	1,0	0,273	0,6	0,078	0,3	0,027	0,2
0,20	1,150	1,1	0,329	0,6	0,094	0,4	0,032	0,2
0,30	2,370	1,6	0,674	1,0	0,192	0,6	0,065	0,4
0,40	3,971	2,1	1,124	1,3	0,319	0,8	0,108	0,5
0,50	5,939	2,7	1,675	1,6	0,474	0,9	0,160	0,6
0,60	8,266	3,2	2,322	1,9	0,655	1,1	0,221	0,7
0,70			3,064	2,2	0,863	1,3	0,291	0,8
0,80			3,900	2,5	1,095	1,5	0,369	1,0
0,90			4,826	2,9	1,352	1,7	0,455	1,1
1,00			5,844	3,2	1,634	1,9	0,549	1,2
1,20					2,269	2,3	0,760	1,4
1,40					2,998	2,6	1,001	1,7
1,60					3,819	3,0	1,273	1,9
1,80					4,732	3,4	1,574	2,2
2,00							1,903	2,4
2,20							2,262	2,6
2,40							2,649	2,9
2,60							3,064	3,1
2,80							3,507	3,4

PP-R S5 (PN10) PIPES

water temperature = 50 °C

	20 × 1,9 mm		25 × 2,3 mm		32 × 2,9 mm		40 × 3,7 mm		50 × 4,6 mm		63 × 5,8 mm		75 × 6,8 mm		90 × 8,2 mm		110 × 10 mm	
Q	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v
l/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s
0,01	0,005	0,1																
0,02	0,016	0,1	0,005	0,1														
0,03	0,033	0,2	0,009	0,1	0,003	0,1												
0,04	0,055	0,2	0,016	0,1	0,004	0,1												
0,05	0,081	0,3	0,023	0,2	0,007	0,1	0,002	0,1										
0,06	0,112	0,3	0,032	0,2	0,009	0,1	0,003	0,1										
0,07	0,147	0,4	0,042	0,2	0,012	0,1	0,004	0,1	0,001	0,1								
0,08	0,186	0,4	0,053	0,3	0,015	0,2	0,005	0,1	0,002	0,1								
0,09	0,229	0,5	0,065	0,3	0,019	0,2	0,006	0,1	0,002	0,1								
0,10	0,277	0,5	0,079	0,3	0,023	0,2	0,008	0,1	0,003	0,1								
0,12	0,383	0,6	0,109	0,4	0,031	0,2	0,011	0,1	0,004	0,1	0,001	0,1						
0,14	0,505	0,8	0,143	0,4	0,041	0,3	0,014	0,2	0,005	0,1	0,002	0,1						
0,16	0,642	0,9	0,182	0,5	0,052	0,3	0,018	0,2	0,006	0,1	0,002	0,1	0,001	0,1				
0,18	0,793	1,0	0,224	0,6	0,064	0,3	0,022	0,2	0,007	0,1	0,002	0,1	0,001	0,1				
0,20	0,959	1,1	0,271	0,6	0,077	0,4	0,026	0,2	0,009	0,2	0,003	0,1	0,001	0,1				
0,30	2,003	1,6	0,561	1,0	0,158	0,6	0,053	0,4	0,018	0,2	0,006	0,1	0,003	0,1	0,001	0,1		
0,40	3,396	2,1	0,943	1,3	0,264	0,8	0,089	0,5	0,030	0,3	0,010	0,2	0,004	0,1	0,002	0,1	0,001	0,1
0,50	5,132	2,7	1,417	1,6	0,394	0,9	0,132	0,6	0,045	0,4	0,015	0,2	0,006	0,2	0,003	0,1	0,001	0,1
0,60	7,206	3,2	1,978	1,9	0,548	1,1	0,183	0,7	0,062	0,5	0,021	0,3	0,009	0,2	0,004	0,1	0,001	0,1
0,70			2,628	2,2	0,726	1,3	0,242	0,8	0,082	0,5	0,027	0,3	0,012	0,2	0,005	0,2	0,002	0,1
0,80			3,365	2,5	0,926	1,5	0,307	1,0	0,104	0,6	0,034	0,4	0,015	0,3	0,006	0,2	0,002	0,1
0,90			4,188	2,9	1,148	1,7	0,380	1,1	0,128	0,7	0,042	0,4	0,018	0,3	0,008	0,2	0,003	0,1
1,00			5,097	3,2	1,393	1,9	0,460	1,2	0,155	0,8	0,051	0,5	0,022	0,3	0,009	0,2	0,003	0,2
1,20					1,950	2,3	0,642	1,4	0,215	0,9	0,070	0,6	0,030	0,4	0,013	0,3	0,005	0,2
1,40					2,594	2,6	0,851	1,7	0,284	1,1	0,093	0,7	0,040	0,5	0,017	0,3	0,006	0,2
1,60					3,327	3,0	1,087	1,9	0,362	1,2	0,118	0,8	0,051	0,5	0,021	0,4	0,008	0,3
1,80					4,147	3,4	1,351	2,2	0,449	1,4	0,146	0,9	0,063	0,6	0,026	0,4	0,010	0,3
2,00							1,642	2,4	0,545	1,5	0,177	1,0	0,076	0,7	0,031	0,5	0,012	0,3
2,20							1,961	2,6	0,649	1,7	0,210	1,1	0,090	0,7	0,037	0,5	0,014	0,3
2,40							2,306	2,9	0,761	1,8	0,246	1,2	0,105	0,8	0,043	0,6	0,016	0,4
2,60							2,677	3,1	0,882	2,0	0,284	1,3	0,122	0,9	0,050	0,6	0,019	0,4
2,80							3,076	3,4	1,011	2,1	0,325	1,3	0,139	1,0	0,057	0,7	0,022	0,4
3,00									1,149	2,3	0,369	1,4	0,158	1,0	0,064	0,7	0,024	0,5
3,20									1,296	2,4	0,416	1,5	0,177	1,1	0,072	0,8	0,027	0,5
3,40									1,450	2,6	0,464	1,6	0,198	1,2	0,081	0,8	0,031	0,5
3,60									1,613	2,8	0,516	1,7	0,220	1,2	0,089	0,8	0,034	0,6
3,80									1,785	2,9	0,570	1,8	0,242	1,3	0,099	0,9	0,037	0,6
4,00									1,964	3,1	0,626	1,9	0,266	1,4	0,108	0,9	0,041	0,6
4,20									2,152	3,2	0,686	2,0	0,291	1,4	0,118	1,0	0,045	0,7
4,40									2,349	3,4	0,747	2,1	0,317	1,5	0,129	1,0	0,048	0,7
4,60									2,553	3,5	0,811	2,2	0,344	1,6	0,139	1,1	0,053	0,7
4,80											0,878	2,3	0,372	1,6	0,151	1,1	0,057	0,8
5,00											0,947	2,4	0,401	1,7	0,162	1,2	0,061	0,8

PP-R S3,2 (PN16) PIPES

water temperature = 10 °C

	20 × 2,8 mm		25 × 3,5 mm		32 × 4,4 mm		40 × 5,5 mm		50 × 6,9 mm		63 × 8,6 mm		75 × 10,3 mm		90 × 12,3 mm		110 × 15,1 mm	
Q	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v
l/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s
0,01	0,008	0,1																
0,02	0,027	0,1	0,009	0,1														
0,03	0,056	0,2	0,019	0,1	0,006	0,1												
0,04	0,093	0,2	0,032	0,2	0,010	0,1	0,003	0,1										
0,05	0,137	0,3	0,047	0,2	0,015	0,1	0,005	0,1										
0,06	0,189	0,4	0,065	0,2	0,020	0,1	0,007	0,1	0,002	0,1								
0,07	0,248	0,4	0,085	0,3	0,027	0,2	0,009	0,1	0,003	0,1								
0,08	0,313	0,5	0,108	0,3	0,034	0,2	0,012	0,1	0,004	0,1								
0,09	0,386	0,6	0,133	0,4	0,041	0,2	0,014	0,1	0,005	0,1	0,002	0,1						
0,10	0,465	0,6	0,160	0,4	0,050	0,2	0,017	0,2	0,006	0,1	0,002	0,1						
0,12	0,641	0,7	0,221	0,5	0,069	0,3	0,023	0,2	0,008	0,1	0,003	0,1	0,001	0,1				
0,14	0,843	0,9	0,290	0,6	0,090	0,3	0,031	0,2	0,010	0,1	0,003	0,1	0,002	0,1				
0,16	1,068	1,0	0,367	0,6	0,114	0,4	0,039	0,2	0,013	0,2	0,004	0,1	0,002	0,1				
0,18	1,316	1,1	0,452	0,7	0,140	0,4	0,048	0,3	0,016	0,2	0,005	0,1	0,002	0,1	0,001	0,1		
0,20	1,588	1,2	0,544	0,8	0,168	0,5	0,058	0,3	0,019	0,2	0,006	0,1	0,003	0,1	0,001	0,1		
0,30	3,277	1,8	1,118	1,2	0,345	0,7	0,118	0,5	0,040	0,3	0,013	0,2	0,006	0,1	0,002	0,1	0,001	0,1
0,40	5,499	2,5	1,868	1,6	0,574	1,0	0,196	0,6	0,066	0,4	0,022	0,2	0,010	0,2	0,004	0,1	0,002	0,1
0,50	8,236	3,1	2,786	2,0	0,854	1,2	0,290	0,8	0,097	0,5	0,032	0,3	0,014	0,2	0,006	0,2	0,002	0,1
0,60			3,869	2,4	1,183	1,4	0,401	0,9	0,134	0,6	0,045	0,4	0,020	0,3	0,008	0,2	0,003	0,1
0,70			5,112	2,8	1,558	1,7	0,528	1,1	0,176	0,7	0,058	0,4	0,026	0,3	0,011	0,2	0,004	0,1
0,80			6,513	3,1	1,980	1,9	0,669	1,2	0,223	0,8	0,074	0,5	0,032	0,3	0,014	0,2	0,005	0,2
0,90			8,071	3,5	2,448	2,2	0,826	1,4	0,275	0,9	0,091	0,6	0,040	0,4	0,017	0,3	0,006	0,2
1,00					2,960	2,4	0,997	1,5	0,332	1,0	0,110	0,6	0,048	0,4	0,020	0,3	0,008	0,2
1,20					4,117	2,9	1,382	1,8	0,459	1,2	0,152	0,7	0,066	0,5	0,028	0,4	0,011	0,2
1,40					5,449	3,4	1,824	2,1	0,604	1,4	0,199	0,9	0,087	0,6	0,037	0,4	0,014	0,3
1,60							2,322	2,5	0,767	1,6	0,253	1,0	0,110	0,7	0,046	0,5	0,018	0,3
1,80							2,874	2,8	0,948	1,7	0,311	1,1	0,136	0,8	0,057	0,5	0,022	0,4
2,00							3,480	3,1	1,145	1,9	0,376	1,2	0,164	0,9	0,069	0,6	0,026	0,4
2,20							4,139	3,4	1,360	2,1	0,446	1,3	0,194	1,0	0,081	0,7	0,031	0,4
2,40									1,591	2,3	0,521	1,5	0,227	1,0	0,095	0,7	0,036	0,5
2,60									1,839	2,5	0,601	1,6	0,261	1,1	0,109	0,8	0,041	0,5
2,80									2,104	2,7	0,686	1,7	0,298	1,2	0,125	0,8	0,047	0,6
3,00									2,385	2,9	0,777	1,8	0,337	1,3	0,141	0,9	0,053	0,6
3,20									2,682	3,1	0,873	2,0	0,379	1,4	0,158	1,0	0,060	0,6
3,40									2,995	3,3	0,974	2,1	0,422	1,5	0,176	1,0	0,067	0,7
3,60									3,324	3,5	1,080	2,2	0,468	1,6	0,195	1,1	0,074	0,7
3,80											1,190	2,3	0,515	1,6	0,215	1,1	0,081	0,8
4,00											1,306	2,4	0,565	1,7	0,235	1,2	0,089	0,8
4,20											1,427	2,6	0,617	1,8	0,257	1,3	0,097	0,8
4,40											1,553	2,7	0,671	1,9	0,279	1,3	0,105	0,9
4,60											1,683	2,8	0,727	2,0	0,302	1,4	0,114	0,9
4,80											1,819	2,9	0,785	2,1	0,326	1,4	0,123	1,0
5,00											1,959	3,1	0,845	2,2	0,361	1,5	0,132	1,0

PP-R S3,2 (PN16) PIPES

water temperature = 50 °C

	20 × 2,8 mm		25 × 3,5 mm		32 × 4,4 mm		40 × 5,5 mm		50 × 6,9 mm		63 × 8,6 mm		75 × 10,3 mm		90 × 12,3 mm		110 × 15,1 mm	
Q	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v
l/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s
0,01	0,007	0,1																
0,02	0,022	0,1	0,008	0,1														
0,03	0,045	0,2	0,016	0,1	0,005	0,1												
0,04	0,075	0,2	0,026	0,2	0,008	0,1	0,003	0,1										
0,05	0,112	0,3	0,038	0,2	0,012	0,1	0,004	0,1										
0,06	0,154	0,4	0,053	0,2	0,016	0,1	0,006	0,1	0,002	0,1								
0,07	0,203	0,4	0,070	0,3	0,022	0,2	0,007	0,1	0,002	0,1								
0,08	0,257	0,5	0,088	0,3	0,027	0,2	0,009	0,1	0,003	0,1								
0,09	0,317	0,6	0,108	0,4	0,034	0,2	0,011	0,1	0,004	0,1	0,001	0,1						
0,10	0,382	0,6	0,131	0,4	0,040	0,2	0,014	0,2	0,005	0,1	0,002	0,1						
0,12	0,530	0,7	0,181	0,5	0,056	0,3	0,019	0,2	0,006	0,1	0,002	0,1	0,001	0,1				
0,14	0,698	0,9	0,238	0,6	0,073	0,3	0,025	0,2	0,008	0,1	0,003	0,1	0,001	0,1				
0,16	0,888	1,0	0,302	0,6	0,093	0,4	0,032	0,2	0,011	0,2	0,004	0,1	0,002	0,1				
0,18	1,099	1,1	0,373	0,7	0,115	0,4	0,039	0,3	0,013	0,2	0,004	0,1	0,002	0,1	0,001	0,1		
0,20	1,330	1,2	0,450	0,8	0,138	0,5	0,047	0,3	0,016	0,2	0,005	0,1	0,002	0,1	0,001	0,1		
0,30	2,785	1,8	0,935	1,2	0,285	0,7	0,096	0,5	0,032	0,3	0,011	0,2	0,005	0,1	0,002	0,1	0,001	0,1
0,40	4,731	2,5	1,578	1,6	0,478	1,0	0,161	0,6	0,054	0,4	0,018	0,2	0,008	0,2	0,003	0,1	0,001	0,1
0,50	7,161	3,1	2,376	2,0	0,716	1,2	0,240	0,8	0,080	0,5	0,026	0,3	0,012	0,2	0,005	0,2	0,002	0,1
0,60			3,325	2,4	0,997	1,4	0,334	0,9	0,110	0,6	0,036	0,4	0,016	0,3	0,007	0,2	0,003	0,1
0,70			4,425	2,8	1,322	1,7	0,441	1,1	0,146	0,7	0,048	0,4	0,021	0,3	0,009	0,2	0,003	0,1
0,80			5,675	3,1	1,689	1,9	0,562	1,2	0,185	0,8	0,061	0,5	0,026	0,3	0,011	0,2	0,004	0,2
0,90			7,073	3,5	2,098	2,2	0,696	1,4	0,229	0,9	0,075	0,6	0,033	0,4	0,014	0,3	0,005	0,2
1,00					2,549	2,4	0,843	1,5	0,277	1,0	0,091	0,6	0,039	0,4	0,016	0,3	0,006	0,2
1,20					3,577	2,9	1,178	1,8	0,385	1,2	0,126	0,7	0,055	0,5	0,023	0,4	0,009	0,2
1,40					4,770	3,4	1,565	2,1	0,510	1,4	0,166	0,9	0,072	0,6	0,030	0,4	0,011	0,3
1,60							2,004	2,5	0,650	1,6	0,211	1,0	0,091	0,7	0,038	0,5	0,014	0,3
1,80							2,494	2,8	0,807	1,7	0,261	1,1	0,113	0,8	0,047	0,5	0,018	0,4
2,00							3,036	3,1	0,980	1,9	0,316	1,2	0,136	0,9	0,057	0,6	0,021	0,4
2,20							3,629	3,4	1,168	2,1	0,376	1,3	0,162	1,0	0,067	0,7	0,025	0,4
2,40									1,372	2,3	0,441	1,5	0,190	1,0	0,079	0,7	0,030	0,5
2,60									1,592	2,5	0,511	1,6	0,220	1,1	0,091	0,8	0,034	0,5
2,80									1,828	2,7	0,585	1,7	0,251	1,2	0,104	0,8	0,039	0,6
3,00									2,079	2,9	0,664	1,8	0,285	1,3	0,118	0,9	0,044	0,6
3,20									2,345	3,1	0,748	2,0	0,320	1,4	0,132	1,0	0,050	0,6
3,40									2,627	3,3	0,837	2,1	0,358	1,5	0,148	1,0	0,055	0,7
3,60									2,925	3,5	0,930	2,2	0,398	1,6	0,164	1,1	0,061	0,7
3,80											1,028	2,3	0,439	1,6	0,181	1,1	0,067	0,8
4,00											1,131	2,4	0,483	1,7	0,198	1,2	0,074	0,8
4,20											1,239	2,6	0,528	1,8	0,217	1,3	0,081	0,8
4,40											1,351	2,7	0,575	1,9	0,236	1,3	0,088	0,9
4,60											1,468	2,8	0,624	2,0	0,256	1,4	0,095	0,9
4,80											1,589	2,9	0,676	2,1	0,277	1,4	0,103	1,0
5,00											1,716	3,1	0,729	2,2	0,298	1,5	0,111	1,0

PP-R S2,5 (PN20) PIPES

water temperature = 10 °C

	20 × 3,4 mm		25 × 4,2 mm		32 × 5,4 mm		40 × 6,7 mm		50 × 8,3 mm		63 × 10,5 mm		75 × 12,5 mm		90 × 15,0 mm		110 × 18,3 mm	
Q	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v
l/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s
0,01	0,012	0,1																
0,02	0,041	0,1	0,014	0,1	0,004	0,1												
0,03	0,084	0,2	0,028	0,1	0,009	0,1	0,003	0,1										
0,04	0,140	0,3	0,047	0,2	0,015	0,1	0,005	0,1										
0,05	0,207	0,4	0,070	0,2	0,022	0,1	0,007	0,1	0,003	0,1								
0,06	0,286	0,4	0,096	0,3	0,030	0,2	0,010	0,1	0,004	0,1								
0,07	0,375	0,5	0,126	0,3	0,039	0,2	0,013	0,1	0,005	0,1	0,002	0,1						
0,08	0,475	0,6	0,159	0,4	0,050	0,2	0,017	0,1	0,006	0,1	0,002	0,1						
0,09	0,585	0,7	0,196	0,4	0,061	0,3	0,021	0,2	0,007	0,1	0,002	0,1						
0,10	0,704	0,7	0,236	0,5	0,073	0,3	0,025	0,2	0,009	0,1	0,003	0,1	0,001	0,1				
0,12	0,973	0,9	0,325	0,6	0,101	0,3	0,034	0,2	0,012	0,1	0,004	0,1	0,002	0,1				
0,14	1,279	1,0	0,427	0,6	0,133	0,4	0,045	0,3	0,016	0,2	0,005	0,1	0,002	0,1	0,001	0,1		
0,16	1,622	1,2	0,540	0,7	0,168	0,5	0,057	0,3	0,020	0,2	0,006	0,1	0,003	0,1	0,001	0,1		
0,18	2,000	1,3	0,665	0,8	0,206	0,5	0,070	0,3	0,024	0,2	0,008	0,1	0,003	0,1	0,001	0,1		
0,20	2,414	1,5	0,802	0,9	0,249	0,6	0,084	0,4	0,029	0,2	0,010	0,1	0,004	0,1	0,002	0,1		
0,30	4,994	2,2	1,650	1,4	0,510	0,8	0,172	0,5	0,060	0,3	0,019	0,2	0,008	0,2	0,004	0,1	0,001	0,1
0,40	8,397	2,9	2,761	1,8	0,849	1,1	0,286	0,7	0,099	0,5	0,032	0,3	0,014	0,2	0,006	0,1	0,002	0,1
0,50			4,125	2,3	1,264	1,4	0,425	0,9	0,147	0,6	0,048	0,4	0,021	0,3	0,009	0,2	0,003	0,1
0,60			5,735	2,8	1,752	1,7	0,587	1,1	0,203	0,7	0,066	0,4	0,029	0,3	0,012	0,2	0,005	0,1
0,70			7,585	3,2	2,311	2,0	0,773	1,3	0,267	0,8	0,087	0,5	0,038	0,4	0,016	0,2	0,006	0,2
0,80					2,939	2,3	0,981	1,4	0,338	0,9	0,110	0,6	0,048	0,4	0,020	0,3	0,008	0,2
0,90					3,635	2,5	1,211	1,6	0,417	1,0	0,135	0,6	0,059	0,5	0,025	0,3	0,010	0,2
1,00					4,399	2,8	1,463	1,8	0,503	1,2	0,163	0,7	0,071	0,5	0,030	0,4	0,011	0,2
1,20					6,127	3,4	2,031	2,2	0,696	1,4	0,225	0,9	0,097	0,6	0,041	0,4	0,016	0,3
1,40							2,683	2,5	0,917	1,6	0,296	1,0	0,128	0,7	0,054	0,5	0,021	0,3
1,60							3,417	2,9	1,165	1,8	0,375	1,2	0,162	0,8	0,068	0,6	0,026	0,4
1,80							4,233	3,2	1,441	2,1	0,463	1,3	0,200	0,9	0,083	0,6	0,032	0,4
2,00									1,742	2,3	0,559	1,4	0,241	1,0	0,101	0,7	0,039	0,5
2,20									2,070	2,5	0,663	1,6	0,286	1,1	0,119	0,8	0,046	0,5
2,40									2,423	2,8	0,775	1,7	0,334	1,2	0,139	0,8	0,054	0,6
2,60									2,803	3,0	0,894	1,9	0,385	1,3	0,160	0,9	0,062	0,6
2,80									3,208	3,2	1,022	2,0	0,440	1,4	0,183	1,0	0,070	0,7
3,00									3,638	3,5	1,158	2,2	0,498	1,5	0,207	1,1	0,080	0,7
3,20											1,301	2,3	0,559	1,6	0,232	1,1	0,089	0,8
3,40											1,452	2,5	0,623	1,7	0,259	1,2	0,099	0,8
3,60											1,610	2,6	0,691	1,8	0,286	1,3	0,110	0,9
3,80											1,776	2,7	0,761	1,9	0,316	1,3	0,121	0,9
4,00											1,949	2,9	0,835	2,0	0,346	1,4	0,133	1,0
4,20											2,131	3,0	0,912	2,1	0,377	1,5	0,145	1,0
4,40											2,319	3,2	0,992	2,2	0,410	1,6	0,157	1,0
4,60											2,515	3,3	1,075	2,3	0,444	1,6	0,170	1,1
4,80											2,718	3,5	1,161	2,4	0,480	1,7	0,184	1,1
5,00													1,251	2,5	0,516	1,8	0,198	1,2

PP-R S2,5 (PN20) PIPES

water temperature = 50 °C

	20 × 3,4 mm		25 × 4,2 mm		32 × 5,4 mm		40 × 6,7 mm		50 × 8,3 mm		63 × 10,5 mm		75 × 12,5 mm		90 × 15,0 mm		110 × 18,3 mm	
Q	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v
l/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s
0,01	0,010	0,1																
0,02	0,034	0,1	0,011	0,1	0,004	0,1												
0,03	0,069	0,2	0,023	0,1	0,007	0,1	0,002	0,1										
0,04	0,114	0,3	0,038	0,2	0,012	0,1	0,004	0,1										
0,05	0,169	0,4	0,057	0,2	0,018	0,1	0,006	0,1	0,002	0,1								
0,06	0,234	0,4	0,078	0,3	0,024	0,2	0,008	0,1	0,003	0,1								
0,07	0,308	0,5	0,102	0,3	0,032	0,2	0,011	0,1	0,004	0,1	0,001	0,1						
0,08	0,390	0,6	0,130	0,4	0,040	0,2	0,014	0,1	0,005	0,1	0,002	0,1						
0,09	0,482	0,7	0,160	0,4	0,050	0,3	0,017	0,2	0,006	0,1	0,002	0,1						
0,10	0,582	0,7	0,193	0,5	0,060	0,3	0,020	0,2	0,007	0,1	0,002	0,1	0,001	0,1				
0,12	0,807	0,9	0,267	0,6	0,082	0,3	0,028	0,2	0,010	0,1	0,003	0,1	0,001	0,1				
0,14	1,065	1,0	0,351	0,6	0,108	0,4	0,037	0,3	0,013	0,2	0,004	0,1	0,002	0,1	0,001	0,1		
0,16	1,356	1,2	0,446	0,7	0,137	0,5	0,046	0,3	0,016	0,2	0,005	0,1	0,002	0,1	0,001	0,1		
0,18	1,679	1,3	0,551	0,8	0,169	0,5	0,057	0,3	0,020	0,2	0,006	0,1	0,003	0,1	0,001	0,1		
0,20	2,033	1,5	0,666	0,9	0,204	0,6	0,069	0,4	0,024	0,2	0,008	0,1	0,003	0,1	0,001	0,1		
0,30	4,273	2,2	1,388	1,4	0,423	0,8	0,141	0,5	0,049	0,3	0,016	0,2	0,007	0,2	0,003	0,1	0,001	0,1
0,40	7,281	2,9	2,348	1,8	0,710	1,1	0,236	0,7	0,081	0,5	0,026	0,3	0,011	0,2	0,005	0,1	0,002	0,1
0,50			3,541	2,3	1,065	1,4	0,353	0,9	0,121	0,6	0,039	0,4	0,017	0,3	0,007	0,2	0,003	0,1
0,60			4,964	2,8	1,486	1,7	0,491	1,1	0,168	0,7	0,054	0,4	0,023	0,3	0,010	0,2	0,004	0,1
0,70			6,616	3,2	1,972	2,0	0,649	1,3	0,221	0,8	0,071	0,5	0,031	0,4	0,013	0,2	0,005	0,2
0,80					2,523	2,3	0,828	1,4	0,281	0,9	0,090	0,6	0,039	0,4	0,016	0,3	0,006	0,2
0,90					3,138	2,5	1,027	1,6	0,348	1,0	0,111	0,6	0,048	0,5	0,020	0,3	0,008	0,2
1,00					3,816	2,8	1,245	1,8	0,421	1,2	0,135	0,7	0,058	0,5	0,024	0,4	0,009	0,2
1,20					5,364	3,4	1,742	2,2	0,587	1,4	0,187	0,9	0,080	0,6	0,033	0,4	0,013	0,3
1,40							2,317	2,5	0,778	1,6	0,247	1,0	0,106	0,7	0,044	0,5	0,017	0,3
1,60							2,971	2,9	0,994	1,8	0,315	1,2	0,135	0,8	0,056	0,6	0,021	0,4
1,80							3,702	3,2	1,235	2,1	0,390	1,3	0,167	0,9	0,069	0,6	0,026	0,4
2,00									1,501	2,3	0,473	1,4	0,202	1,0	0,083	0,7	0,032	0,5
2,20									1,791	2,5	0,563	1,6	0,240	1,1	0,099	0,8	0,038	0,5
2,40									2,106	2,8	0,660	1,7	0,281	1,2	0,116	0,8	0,044	0,6
2,60									2,445	3,0	0,765	1,9	0,325	1,3	0,134	0,9	0,051	0,6
2,80									2,809	3,2	0,877	2,0	0,373	1,4	0,153	1,0	0,058	0,7
3,00									3,197	3,5	0,996	2,2	0,423	1,5	0,174	1,1	0,066	0,7
3,20											1,123	2,3	0,476	1,6	0,195	1,1	0,074	0,8
3,40											1,256	2,5	0,532	1,7	0,218	1,2	0,083	0,8
3,60											1,397	2,6	0,591	1,8	0,242	1,3	0,092	0,9
3,80											1,545	2,7	0,653	1,9	0,267	1,3	0,101	0,9
4,00											1,701	2,9	0,718	2,0	0,293	1,4	0,111	1,0
4,20											1,863	3,0	0,786	2,1	0,321	1,5	0,121	1,0
4,40											2,033	3,2	0,856	2,2	0,349	1,6	0,132	1,0
4,60											2,210	3,3	0,930	2,3	0,379	1,6	0,143	1,1
4,80											2,394	3,5	1,006	2,4	0,410	1,7	0,155	1,1
5,00													1,086	2,5	0,442	1,8	0,167	1,2

PP-R S2,5 (PN20) PIPES

water temperature = 80 °C

	20 × 3,4 mm		25 × 4,2 mm		32 × 5,4 mm		40 × 6,7 mm		50 × 8,3 mm		63 × 10,5 mm		75 × 12,5 mm		90 × 15,0 mm		110 × 18,3 mm	
Q	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v
l/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s
0,01	0,009	1,1																
0,02	0,030	1,1	0,010	0,1	0,003	0,1												
0,03	0,062	0,2	0,021	0,1	0,006	0,1	0,002	0,1										
0,04	0,104	0,3	0,035	0,2	0,011	0,1	0,004	0,1										
0,05	0,155	0,4	0,051	0,2	0,016	0,1	0,005	0,1	0,002	0,1								
0,06	0,214	0,4	0,071	0,3	0,022	0,2	0,007	0,1	0,003	0,1								
0,07	0,282	0,5	0,094	0,3	0,029	0,2	0,010	0,1	0,003	0,1	0,001	0,1						
0,08	0,359	0,6	0,119	0,4	0,037	0,2	0,012	0,1	0,004	0,1	0,001	0,1						
0,09	0,443	0,7	0,146	0,4	0,045	0,3	0,015	0,2	0,005	0,1	0,002	0,1						
0,10	0,536	0,7	0,177	0,5	0,054	0,3	0,018	0,2	0,006	0,1	0,002	0,1	0,001	0,1				
0,12	0,746	0,9	0,245	0,6	0,075	0,3	0,025	0,2	0,009	0,1	0,003	0,1	0,001	0,1				
0,14	0,988	1,0	0,323	0,6	0,099	0,4	0,033	0,3	0,012	0,2	0,004	0,1	0,002	0,1	0,001	0,1		
0,16	1,261	1,2	0,412	0,7	0,126	0,5	0,042	0,3	0,015	0,2	0,005	0,1	0,002	0,1	0,001	0,1		
0,18	1,565	1,3	0,510	0,8	0,155	0,5	0,052	0,3	0,018	0,2	0,006	0,1	0,003	0,1	0,001	0,1		
0,20	1,900	1,5	0,617	0,9	0,188	0,6	0,063	0,4	0,022	0,2	0,007	0,1	0,003	0,1	0,001	0,1		
0,30	4,031	2,2	1,296	1,4	0,391	0,8	0,130	0,5	0,045	0,3	0,014	0,2	0,006	0,2	0,003	0,1	0,001	0,1
0,40	6,918	2,9	2,206	1,8	0,661	1,1	0,218	0,7	0,075	0,5	0,024	0,3	0,010	0,2	0,004	0,1	0,002	0,1
0,50			3,346	2,3	0,995	1,4	0,327	0,9	0,111	0,6	0,036	0,4	0,015	0,3	0,006	0,2	0,002	0,1
0,60			4,712	2,8	1,395	1,7	0,456	1,1	0,155	0,7	0,050	0,4	0,021	0,3	0,009	0,2	0,003	0,1
0,70			6,304	3,2	1,858	2,0	0,605	1,3	0,205	0,8	0,065	0,5	0,028	0,4	0,012	0,2	0,005	0,2
0,80					2,384	2,3	0,774	1,4	0,261	0,9	0,083	0,6	0,036	0,4	0,015	0,3	0,006	0,2
0,90					2,974	2,5	0,963	1,6	0,324	1,0	0,103	0,6	0,044	0,5	0,018	0,3	0,007	0,2
1,00					3,626	2,8	1,171	1,8	0,392	1,2	0,124	0,7	0,053	0,5	0,022	0,4	0,009	0,2
1,20					5,121	3,4	1,645	2,2	0,549	1,4	0,173	0,9	0,074	0,6	0,031	0,4	0,012	0,3
1,40							2,197	2,5	0,730	1,6	0,230	1,0	0,098	0,7	0,040	0,5	0,016	0,3
1,60							2,826	2,9	0,936	1,8	0,293	1,2	0,125	0,8	0,051	0,6	0,020	0,4
1,80							3,532	3,2	1,166	2,1	0,364	1,3	0,155	0,9	0,064	0,6	0,024	0,4
2,00									1,421	2,3	0,443	1,4	0,188	1,0	0,077	0,7	0,029	0,5
2,20									1,700	2,5	0,528	1,6	0,224	1,1	0,092	0,8	0,035	0,5
2,40									2,003	2,8	0,621	1,7	0,263	1,2	0,107	0,8	0,041	0,6
2,60									2,331	3,0	0,721	1,9	0,304	1,3	0,124	0,9	0,047	0,6
2,80									2,682	3,2	0,828	2,0	0,349	1,4	0,142	1,0	0,054	0,7
3,00									3,058	3,5	0,942	2,2	0,397	1,5	0,162	1,1	0,061	0,7
3,20											1,064	2,3	0,447	1,6	0,182	1,1	0,069	0,8
3,40											1,192	2,5	0,501	1,7	0,204	1,2	0,077	0,8
3,60											1,328	2,6	0,557	1,8	0,226	1,3	0,085	0,9
3,80											1,471	2,7	0,616	1,9	0,250	1,3	0,094	0,9
4,00											1,621	2,9	0,679	2,0	0,275	1,4	0,103	1,0
4,20											1,778	3,0	0,744	2,1	0,301	1,5	0,113	1,0
4,40											1,942	3,2	0,812	2,2	0,328	1,6	0,123	1,0
4,60											2,113	3,3	0,882	2,3	0,356	1,6	0,134	1,1
4,80											2,292	3,5	0,956	2,4	0,386	1,7	0,145	1,1
5,00													1,033	2,5	0,416	1,8	0,156	1,2

UNIBETA PIPES S3,2/S4/S5

water temperature = 10 °C

Water temperature = 10 °C																																						
16 × 2,2 mm			20 × 2,8 mm			25 × 2,8 mm			32 × 3,6 mm			40 × 4,5 mm			50 × 5,6 mm			63 × 7,1 mm			75 × 8,4 mm			90 × 10,1 mm			110 × 12,3 mm			125 × 14,0 mm			160 x 14,6 mm			200 x 18,2 mm		
Q	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v						
l/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s						
0,02	0,083	0,2	0,027	0,1	0,001	0,1																																
0,04	0,282	0,4	0,093	0,2	0,015	0,2																																
0,06	0,576	0,6	0,189	0,4	0,033	0,2	0,008	0,1																														
0,08	0,958	0,8	0,313	0,5	0,076	0,3	0,020	0,2	0,006	0,1																												
0,10	1,422	1,0	0,465	0,6	0,113	0,4	0,036	0,2	0,009	0,2																												
0,12	1,967	1,2	0,641	0,7	0,156	0,5	0,049	0,3	0,016	0,2	0,004	0,1																										
0,14	2,588	1,4	0,843	0,9	0,198	0,6	0,063	0,3	0,023	0,2	0,007	0,1																										
0,16	3,285	1,6	1,068	1,0	0,252	0,6	0,078	0,4	0,027	0,2	0,010	0,2																										
0,18	4,056	1,8	1,316	1,1	0,312	0,7	0,095	0,4	0,034	0,3	0,011	0,2	0,004	0,1																								
0,20	4,900	2,0	1,588	1,2	0,377	0,8	0,114	0,5	0,039	0,3	0,014	0,2	0,005	0,1	0,002	0,1																						
0,30	10,182	2,9	3,277	1,8	0,757	1,2	0,235	0,7	0,082	0,5	0,027	0,3	0,010	0,2	0,004	0,1																						
0,40			5,499	2,5	1,268	1,6	0,393	1,0	0,134	0,6	0,047	0,4	0,015	0,2	0,010	0,2	0,003	0,1																				
0,50			8,236	3,1	1,895	2,0	0,586	1,2	0,198	0,8	0,067	0,5	0,023	0,3	0,014	0,2	0,004	0,1																				
0,60					2,635	2,4	0,801	1,4	0,272	0,9	0,095	0,6	0,031	0,4	0,017	0,3	0,006	0,2																				
0,70					2,487	2,8	1,351	1,7	0,363	1,1	0,122	0,7	0,040	0,4	0,022	0,3	0,007	0,2	0,003	0,1																		
0,80					4,449	3,1	2,012	1,9	0,458	1,2	0,157	0,8	0,053	0,5	0,028	0,3	0,010	0,2	0,004	0,1																		
0,90					5,484	3,5	2,792	2,2	0,564	1,4	0,192	0,9	0,064	0,6	0,034	0,4	0,012	0,2	0,005	0,2																		
1,00							3,713	2,4	0,678	1,5	0,234	1,0	0,076	0,6	0,046	0,5	0,014	0,3	0,005	0,2	0,003	0,1																
1,20							4,729	2,9	0,948	1,8	0,318	1,2	0,106	0,7	0,061	0,5	0,019	0,3	0,007	0,2	0,004	0,2																
1,40							5,559	3,4	1,246	2,1	0,420	1,4	0,141	0,9	0,076	0,6	0,026	0,4	0,009	0,2	0,005	0,2																
1,60									1,594	2,5	0,535	1,6	0,180	1,0	0,095	0,7	0,032	0,4	0,012	0,3	0,007	0,2	0,001	0,1														
1,80									1,967	2,8	0,662	1,7	0,219	1,1	0,113	0,8	0,039	0,5	0,015	0,3	0,008	0,2	0,001	0,1														
2,00									2,392	3,1	0,802	1,9	0,266	1,2	0,136	0,8	0,047	0,5	0,018	0,4	0,010	0,3	0,002	0,1														
2,20									2,838	3,4	0,954	2,1	0,314	1,3	0,157	0,9	0,055	0,6	0,021	0,4	0,012	0,3	0,002	0,1														
2,40											1,118	2,3	0,366	1,5	0,183	1,0	0,066	0,6	0,025	0,4	0,013	0,3	0,003	0,1														
2,60											1,294	2,5	0,425	1,6	0,207	1,1	0,076	0,7	0,028	0,5	0,016	0,4	0,004	0,1														
2,80											1,481	2,7	0,487	1,7	0,236	1,1	0,086	0,7	0,033	0,5	0,018	0,4	0,004	0,1	0,001	0,1												
3,00											1,681	2,9	0,548	1,8	0,263	1,2	0,097	0,8	0,037	0,5	0,021	0,4	0,005	0,1	0,002	0,1												
3,20											1,892	3,1	0,618	2,0	0,295	1,3	0,111	0,8	0,042	0,6	0,022	0,4	0,005	0,1	0,002	0,1												
3,40											2,115	3,3	0,692	2,1	0,325	1,4	0,123	0,9	0,046	0,6	0,025	0,5	0,006	0,1	0,002	0,1												
3,60											2,335	3,5	0,763	2,2	0,360	1,4	0,135	0,9	0,052	0,6	0,028	0,5	0,007	0,1	0,002	0,1												
3,80														0,844	2,3	0,393	1,5	0,149	1,0	0,056	0,7	0,03	0,5	0,007	0,1	0,002	0,1											
4,00														0,929	2,4	0,432	1,6	0,165	1,1	0,062	0,7	0,034	0,5	0,008	0,1	0,002	0,1											
4,20														1,018	2,6	0,467	1,7	0,18	1,1	0,067	0,7	0,037	0,6	0,009	0,1	0,002	0,1											
4,40														1,102	2,7	0,509	1,7	0,195	1,2	0,074	0,8	0,041	0,6	0,010	0,1	0,002	0,1											
4,60														1,198	2,8	0,547	1,8	0,21	1,2	0,079	0,8	0,043	0,6	0,010	0,1	0,002	0,1											
4,80														1,297	2,9	0,592	1,9	0,226	1,3	0,086	0,8	0,047	0,7	0,011	0,1	0,002	0,1											
5,00														1,391	3,1	0,632	2,0	0,246	1,3	0,092	0,9	0,051	0,7	0,012	0,1	0,002	0,1											
5,20																0,680	2,0	0,264	1,4	0,100	0,9	0,053	0,7	0,013	0,1	0,002	0,1											
5,40																0,730	2,1	0,281	1,4	0,106	0,9	0,058	0,7	0,013	0,1	0,002	0,1											
5,60																0,775	2,2	0,300	1,5	0,114	1,0	0,062	0,8	0,015	0,1	0,002	0,1											
5,80																0,828	2,3	0,322	1,5	0,120	1,0	0,065	0,8	0,016	0,1	0,002	0,1											
6,00																0,875	2,3	0,342	1,6	0,129	1,1	0,069	0,8	0,017	0,1	0,002	0,1											
6,50																0,952	2,4	0,395	1,7	0,147	1,1	0,080	0,9	0,019	0,1	0,002	0,1											
7,00																1,154	2,7	0,451	1,8	0,169	1,2	0,092	1,0	0,022	0,1	0,002	0,1											
7,50																1,241	2,9	0,512	2,0	0,193	1,3	0,103	1,0	0,025	0,1	0,002	0,1											
8,00																1,399	3,0	0,575	2,1	0,217	1,4	0,116	1,1	0,028	0,1	0,002	0,1											
8,50																		0,642	2,2	0,240	1,5	0,130	1,2	0,031	0,1	0,002	0,1											
9,00																		0,713	2,4	0,267	1,6	0,145	1,2	0,034	0,1	0,002	0,1											
9,50																		0,786	2,5	0,296	1,7	0,160	1,3	0,038	0,1	0,002	0,1											
10,00																		0,864	2,6	0,326	1,8	0,174	1,4	0,041	0,1	0,002	0,1											
10,50																		0,944	2,7	0,353	1,8	0,191	1,4	0,045	0,1	0,002	0,1											
11,00																		1,028	2,9	0,386	1,9	0,208	1,5	0,049	0,1	0,002	0,1											
11,50																		1,122	3,0	0,419	2,0	0,226	1,6	0,054	0,1	0,002	0,1											
12,00																				0,450	2,1	0,243	1,6	0,057	0,1	0,002	0,1											
12,50																				0,486	2,2	0,262	1,7	0,062	0,1	0,002	0,1											
13,00																				0,524	2,3	0,282	1,8	0,067	0,1	0,002	0,1											
13,50																				0,563	2,4	0,303	1,8	0,070	0,1	0,002	0,1											
14,00																																						

UNIBETA PIPES S3,2/S4/S5

water temperature = 50 °C

Water temperature = 50 °C																										
16 × 2,2 mm			20 × 2,8 mm		25 × 2,8 mm		32 × 3,6 mm		40 × 4,5 mm		50 × 5,6 mm		63 × 7,1 mm		75 × 8,4 mm		90 × 10,1 mm		110 × 12,3 mm		125 × 14,0 mm		160 × 14,6 mm		200 × 18,2 mm	
Q	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v
l/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s
0,02	0,068	0,2	0,022	0,1	0,004	0,1																				
0,04	0,230	0,4	0,075	0,2	0,019	0,2	0,005	0,1	0,001	0,1																
0,06	0,473	0,6	0,154	0,4	0,035	0,2	0,011	0,1	0,004	0,1	0,001	0,1														
0,08	0,792	0,8	0,257	0,5	0,06	0,3	0,019	0,2	0,007	0,1	0,002	0,1														
0,10	1,183	1,0	0,382	0,6	0,089	0,4	0,028	0,2	0,009	0,2	0,003	0,1	0,001	0,1												
0,12	1,644	1,2	0,53	0,7	0,124	0,5	0,038	0,3	0,013	0,2	0,004	0,1	0,001	0,1												
0,14	2,175	1,4	0,698	0,9	0,158	0,6	0,05	0,3	0,018	0,2	0,006	0,1	0,002	0,1												
0,16	2,773	1,6	0,888	1,0	0,206	0,6	0,062	0,4	0,021	0,2	0,008	0,2	0,002	0,1												
0,18	3,439	1,8	1,099	1,1	0,252	0,7	0,076	0,4	0,027	0,3	0,009	0,2	0,003	0,1	0,001	0,1										
0,20	4,172	2,0	1,330	1,2	0,306	0,8	0,091	0,5	0,031	0,3	0,011	0,2	0,004	0,1	0,002	0,1										
0,30	8,828	2,9	2,785	1,8	0,624	1,2	0,191	0,7	0,066	0,5	0,022	0,3	0,007	0,2	0,003	0,1	0,001	0,1								
0,40			4,731	2,5	1,059	1,6	0,323	1,0	0,109	0,6	0,037	0,4	0,012	0,2	0,005	0,2	0,002	0,1								
0,50			7,161	3,1	1,599	2,0	0,486	1,2	0,162	0,8	0,055	0,5	0,025	0,3	0,008	0,2	0,003	0,1								
0,60					2,242	2,4	0,669	1,4	0,224	0,9	0,077	0,6	0,035	0,4	0,011	0,3	0,005	0,2								
0,70					2,989	2,8	0,891	1,7	0,301	1,1	0,100	0,7	0,038	0,4	0,014	0,3	0,006	0,2	0,002	0,1						
0,80					3,837	3,1	1,142	1,9	0,382	1,2	0,129	0,8	0,043	0,5	0,018	0,3	0,008	0,2	0,003	0,1						
0,90					4,757	3,5	1,409	2,2	0,471	1,4	0,159	0,9	0,052	0,6	0,023	0,4	0,010	0,2	0,004	0,2						
1,00							1,718	2,4	0,570	1,5	0,194	1,0	0,062	0,6	0,028	0,5	0,011	0,3	0,004	0,2	0,002	0,1				
1,20							2,404	2,9	0,802	1,8	0,265	1,2	0,088	0,7	0,037	0,5	0,015	0,3	0,006	0,2	0,003	0,2				
1,40							3,221	3,4	1,062	2,1	0,352	1,4	0,117	0,9	0,05	0,6	0,021	0,4	0,008	0,2	0,004	0,2				
1,60									1,366	2,5	0,451	1,6	0,150	1,0	0,063	0,7	0,026	0,4	0,010	0,3	0,006	0,2	0,001	0,119		
1,80									1,694	2,8	0,561	1,7	0,183	1,1	0,079	0,8	0,032	0,5	0,012	0,3	0,007	0,2	0,002	0,134		
2,00									2,071	3,1	0,682	1,9	0,223	1,2	0,094	0,8	0,039	0,5	0,015	0,4	0,008	0,3	0,002	0,149		
2,20									2,467	3,4	0,815	2,1	0,266	1,3	0,113	0,9	0,046	0,6	0,017	0,4	0,010	0,3	0,002	0,164		
2,40											0,958	2,3	0,309	1,5	0,131	1,0	0,055	0,6	0,021	0,4	0,011	0,3	0,003	0,179		
2,60											1,113	2,5	0,36	1,6	0,153	1,1	0,063	0,7	0,023	0,5	0,013	0,4	0,003	0,194		
2,80											1,279	2,7	0,414	1,7	0,174	1,1	0,072	0,7	0,027	0,5	0,015	0,4	0,004	0,208		
3,00											1,455	2,9	0,467	1,8	0,199	1,2	0,081	0,8	0,03	0,5	0,017	0,4	0,004	0,223	0,001	
3,20											1,642	3,1	0,528	2,0	0,222	1,3	0,093	0,8	0,035	0,6	0,017	0,4	0,005	0,238	0,002	
3,40											1,841	3,3	0,592	2,1	0,25	1,4	0,103	0,9	0,038	0,6	0,021	0,5	0,005	0,253	0,002	
3,60											2,038	3,5	0,654	2,2	0,275	1,4	0,114	0,9	0,043	0,6	0,023	0,5	0,006	0,268	0,002	
3,80														0,725	2,3	0,306	1,5	0,125	1,0	0,047	0,7	0,025	0,5	0,006	0,283	0,002
4,00														0,800	2,4	0,334	1,6	0,139	1,1	0,047	0,7	0,027	0,5	0,007	0,298	0,002
4,20														0,878	2,6	0,368	1,7	0,152	1,1	0,056	0,7	0,031	0,6	0,007	0,313	0,003
4,40														0,953	2,7	0,399	1,7	0,164	1,2	0,062	0,8	0,034	0,6	0,008	0,328	0,003
4,60														1,038	2,8	0,435	1,8	0,178	1,2	0,066	0,8	0,036	0,6	0,008	0,343	0,003
4,80														1,126	2,9	0,469	1,9	0,192	1,3	0,073	0,8	0,039	0,7	0,009	0,357	0,003
5,00														1,210	3,1	0,508	2	0,209	1,3	0,077	0,9	0,042	0,7	0,010	0,372	0,003
5,20																0,544	2	0,224	1,4	0,084	0,9	0,045	0,7	0,011	0,387	0,004
5,40																0,586	2,1	0,239	1,4	0,089	0,9	0,048	0,7	0,011	0,402	0,004
5,60																0,623	2,2	0,255	1,5	0,096	1,0	0,052	0,8	0,012	0,417	0,004
5,80																0,669	2,3	0,275	1,5	0,102	1,0	0,054	0,8	0,013	0,432	0,005
6,00																0,716	2,3	0,292	1,6	0,109	1,1	0,058	0,8	0,013	0,447	0,005
6,50																0,826	2,4	0,338	1,7	0,125	1,1	0,067	0,9	0,016	0,484	0,005
7,00																0,95	2,7	0,388	1,8	0,144	1,2	0,078	1,0	0,018	0,521	0,006
7,50																1,083	2,9	0,441	2,0	0,164	1,3	0,087	1,0	0,021	0,558	0,007
8,00																1,225	3	0,497	2,1	0,185	1,4	0,098	1,1	0,023	0,596	0,008
8,50																		0,556	2,2	0,205	1,5	0,111	1,2	0,026	0,633	0,009
9,00																		0,618	2,4	0,229	1,6	0,123	1,2	0,029	0,670	0,01
9,50																		0,684	2,5	0,254	1,7	0,137	1,3	0,032	0,707	0,011
10,00																		0,753	2,6	0,280	1,8	0,149	1,4	0,034	0,745	0,012
10,50																		0,824	2,7	0,304	1,8	0,163	1,4	0,038	0,782	0,013
11,00																		0,9	2,9	0,333	1,9	0,178	1,5	0,041	0,819	0,014
11,50																		0,984	3,0	0,362	2,0	0,194	1,6	0,045	0,856	0,015
12,00																			0,39	2,1	0,208	1,6	0,048	0,894	0,016	
12,50																			0,422	2,2	0,225	1,7	0,052	0,931	0,017	
13,00																			0,455	2,3	0,243	1,8	0,056	0,968	0,019	
13,50																			0,489	2,4	0,261	1,8	0,06	1,005	0,02	
14,00																			0,521	2,4	0,277	1,9	0,064	1,042	0,022	
14,50																			0,557	2,5	0,297	2,0	0,069	1,080	0,023	
15,00																			0,595	2,6	0,317	2,0	0,074	1,117	0,024	
15,50																			0,634	2,7	0,337	2,1	0,077	1,154	0,026	
16,00																			0,669	2,8	0,359	2,2	0,082	1,191	0,028	
16,50																			0,711	2,9	0,378	2,2	0,087	1,229	0,029	
17,00																			0,753	3,0	0,400	2,3	0,093	1,266	0,031	
17,50																					0,423	2,4	0,097	1,303	0,032	
18,00																					0,447	2,4	0,102	1,340	0,035	
18,50																										

UNIBETA PIPES S3,2/S4/S5

water temperature = 80 °C

	16 × 2,2 mm		20 × 2,8 mm		25 × 2,8 mm		32 × 3,6 mm		40 × 4,5 mm		50 × 5,6 mm		63 × 7,1 mm		75 × 8,4 mm		90 × 10,1 mm		110 × 12,3 mm		125 × 14,0 mm		160 x 14,6 mm		200 x 18,2 mm	
Q	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v
l/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s
0,02	0,061	0,2	0,019	0,1	0,005	0,1																				
0,04	0,198	0,4	0,067	0,2	0,017	0,2	0,005	0,1	0,002	0,1																
0,06	0,414	0,6	0,134	0,4	0,031	0,2	0,009	0,1	0,003	0,1	0,001	0,1														
0,08	0,686	0,8	0,221	0,5	0,053	0,3	0,017	0,2	0,006	0,1	0,002	0,1														
0,10	1,040	1,0	0,328	0,6	0,079	0,4	0,025	0,2	0,008	0,2	0,003	0,1	0,001	0,1												
0,12	1,462	1,2	0,465	0,7	0,111	0,5	0,034	0,3	0,012	0,2	0,004	0,1	0,001	0,1												
0,14	1,926	1,4	0,612	0,9	0,141	0,6	0,044	0,3	0,016	0,2	0,005	0,1	0,002	0,1												
0,16	2,479	1,6	0,777	1,0	0,181	0,6	0,055	0,4	0,019	0,2	0,007	0,2	0,002	0,1												
0,18	3,067	1,8	0,976	1,1	0,226	0,7	0,068	0,4	0,024	0,3	0,008	0,2	0,003	0,1	0,001	0,1										
0,20	3,496	2,0	1,180	1,2	0,275	0,8	0,081	0,5	0,027	0,3	0,010	0,2	0,003	0,1	0,002	0,1										
0,30	8,047	2,9	2,492	1,8	0,567	1,2	0,172	0,7	0,059	0,5	0,019	0,3	0,007	0,2	0,003	0,1	0,001	0,1								
0,40			4,299	2,5	0,969	1,6	0,292	1,0	0,098	0,6	0,033	0,4	0,011	0,2	0,005	0,2	0,002	0,1								
0,50			6,536	3,1	1,471	2,0	0,442	1,2	0,146	0,8	0,049	0,5	0,017	0,3	0,007	0,2	0,003	0,1								
0,60					2,071	2,4	0,612	1,4	0,203	0,9	0,069	0,6	0,023	0,4	0,010	0,3	0,004	0,2								
0,70					2,774	2,8	0,818	1,7	0,274	1,1	0,090	0,7	0,029	0,4	0,013	0,3	0,005	0,2	0,002	0,1						
0,80					3,574	3,1	1,052	1,9	0,348	1,2	0,117	0,8	0,038	0,5	0,016	0,3	0,007	0,2	0,003	0,1						
0,90					4,445	3,5	1,301	2,2	0,431	1,4	0,143	0,9	0,047	0,6	0,020	0,4	0,009	0,2	0,003	0,2						
1,00							1,591	2,4	0,522	1,5	0,176	1,0	0,056	0,6	0,025	0,5	0,010	0,3	0,004	0,2	0,002	0,1				
1,20							2,236	2,9	0,739	1,8	0,242	1,2	0,079	0,7	0,034	0,5	0,014	0,3	0,005	0,2	0,003	0,2				
1,40							3,001	3,4	0,981	2,1	0,323	1,4	0,106	0,9	0,045	0,6	0,019	0,4	0,007	0,2	0,004	0,2				
1,60									1,267	2,5	0,414	1,6	0,136	1,0	0,057	0,7	0,024	0,4	0,009	0,3	0,005	0,2	0,001	0,119		
1,80									1,576	2,8	0,517	1,7	0,177	1,1	0,071	0,8	0,029	0,5	0,011	0,3	0,006	0,2	0,001	0,134		
2,00									1,931	3,1	0,630	1,9	0,207	1,2	0,085	0,8	0,035	0,5	0,013	0,4	0,007	0,3	0,002	0,149	0,001	
2,20									2,306	3,4	0,734	2,1	0,244	1,3	0,103	0,9	0,041	0,6	0,016	0,4	0,009	0,3	0,002	0,164	0,001	
2,40											0,888	2,3	0,284	1,5	0,119	1,0	0,050	0,6	0,019	0,4	0,010	0,3	0,002	0,179	0,001	
2,60											1,034	2,5	0,331	1,6	0,140	1,1	0,057	0,7	0,021	0,5	0,011	0,4	0,003	0,194	0,001	
2,80											1,190	2,7	0,381	1,7	0,159	1,1	0,065	0,7	0,025	0,5	0,013	0,4	0,003	0,208	0,001	
3,00											1,356	2,9	0,430	1,8	0,182	1,2	0,074	0,8	0,027	0,5	0,015	0,4	0,003	0,223	0,001	
3,20											1,534	3,1	0,487	2,0	0,203	1,3	0,084	0,8	0,031	0,6	0,017	0,4	0,004	0,238	0,001	
3,40											1,721	3,3	0,548	2,1	0,229	1,4	0,094	0,9	0,035	0,6	0,019	0,5	0,004	0,253	0,002	
3,60											1,908	3,5	0,606	2,2	0,253	1,4	0,104	0,9	0,039	0,6	0,021	0,5	0,005	0,268	0,002	
3,80													0,673	2,3	0,282	1,5	0,114	1,0	0,042	0,7	0,023	0,5	0,005	0,283	0,002	
4,00													0,743	2,4	0,308	1,6	0,127	1,1	0,047	0,7	0,025	0,5	0,006	0,298	0,002	
4,20													0,817	2,6	0,340	1,7	0,139	1,1	0,051	0,7	0,028	0,6	0,006	0,313	0,002	
4,40													0,887	2,7	0,368	1,7	0,151	1,2	0,056	0,8	0,031	0,6	0,007	0,328	0,002	
4,60													0,697	2,8	0,403	1,8	0,163	1,2	0,06	0,8	0,032	0,6	0,008	0,343	0,003	
4,80													1,051	2,9	0,434	1,9	0,176	1,3	0,066	0,8	0,035	0,7	0,008	0,357	0,003	
5,00													1,130	3,1	0,471	2,0	0,192	1,3	0,071	0,9	0,038	0,7	0,009	0,372	0,003	
5,20															0,504	2,0	0,206	1,4	0,077	0,9	0,041	0,7	0,010	0,387	0,003	
5,40															0,544	2,1	0,221	1,4	0,081	0,9	0,044	0,7	0,010	0,402	0,004	
5,60															0,585	2,2	0,235	1,5	0,088	1,0	0,047	0,8	0,011	0,417	0,004	
5,80															0,622	2,3	0,254	1,5	0,093	1,0	0,05	0,8	0,012	0,432	0,004	
6,00															0,666	2,3	0,270	1,6	0,100	1,1	0,053	0,8	0,013	0,447	0,004	
6,50															0,77	2,4	0,313	1,7	0,115	1,1	0,062	0,9	0,014	0,484	0,005	
7,00															0,888	2,7	0,360	1,8	0,132	1,2	0,071	1,0	0,016	0,521	0,006	
7,50															1,013	2,9	0,409	2,0	0,151	1,3	0,080	1,0	0,019	0,558	0,006	
8,00															1,147	3,0	0,462	2,1	0,171	1,4	0,090	1,1	0,021	0,596	0,007	
8,50																	0,517	2,2	0,189	1,5	0,102	1,2	0,023	0,633	0,008	
9,00																	0,576	2,4	0,212	1,6	0,113	1,2	0,026	0,670	0,009	
9,50																	0,638	2,5	0,235	1,7	0,126	1,3	0,029	0,707	0,01	
10,00																	0,703	2,6	0,259	1,8	0,137	1,4	0,031	0,745	0,011	
10,50																	0,771	2,7	0,282	1,8	0,151	1,4	0,035	0,782	0,012	
11,00																	0,842	2,9	0,309	1,9	0,165	1,5	0,039	0,819	0,013	
11,50																	0,922	3,0	0,337	2,0	0,180	1,6	0,041	0,856	0,014	
12,00																			0,362	2,1	0,192	1,6	0,044	0,894	0,015	
12,50																			0,393	2,2	0,209	1,7	0,048	0,931	0,016	
13,00																			0,424	2,3	0,225	1,8	0,052	0,968	0,017	
13,50																			0,456	2,4	0,242	1,8	0,055	1,005	0,018	
14,00																			0,486	2,4	0,257	1,9	0,059	1,042	0,02	
14,50																			0,520	2,5	0,276	2,0	0,063	1,08	0,021	
15,00																			0,556	2,6	0,295	2,0	0,068	1,117	0,022	
15,50																			0,593	2,7	0,314	2,1	0,071	1,154	0,024	
16,00																			0,627	2,8	0,334	2,2	0,076	1,191	0,025	
16,50																			0,666	2,9	0,352	2,2	0,081	1,229	0,026	
17,00																			0,706	3,0	0,373	2,3	0,085	1,266	0,028	
17,50																					0,395	2,4	0,089	1,303	0,03	
18,00																					0,417	2,4	0,094	1,340	0,032	
18,50																					0,437	2,5	0,100			

water temperature = 10 °C

water temperature = 10 °C																										
16 × 2,2 mm			20 × 2,8 mm			25 × 2,8 mm			32 × 3,6 mm			40 × 4,5 mm		50 × 5,6 mm		63 × 7,1 mm		75 × 8,4 mm		90 × 10,1 mm		110 × 12,3 mm		125 × 14,0 mm		
Q	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v
l/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s
0,02	0,083	0,2	0,027	0,1	0,009	0,1																				
0,04	0,028	0,4	0,093	0,2	0,032	0,2																				
0,06	0,576	0,6	0,189	0,4	0,065	0,2	0,020	0,1																		
0,08	0,958	0,8	0,313	0,5	0,108	0,3	0,034	0,2	0,012	0,1																
0,10	0,422	1,0	0,465	0,6	0,16	0,4	0,050	0,2	0,017	0,2																
0,12	0,967	1,2	0,641	0,7	0,221	0,5	0,069	0,3	0,023	0,2	0,008	0,1														
0,14	2,588	1,4	0,843	0,9	0,290	0,6	0,090	0,3	0,031	0,2	0,010	0,1														
0,16	3,285	1,6	1,068	1,0	0,367	0,6	0,114	0,4	0,039	0,2	0,013	0,2														
0,18	4,056	1,8	1,316	1,1	0,452	0,7	0,140	0,4	0,048	0,3	0,016	0,2	0,005	0,1												
0,20	4,900	2,0	1,588	1,2	0,544	0,8	0,168	0,5	0,058	0,3	0,019	0,2	0,006	0,1	0,002	0,1										
0,30	10,182	2,9	3,277	1,8	1,118	1,2	0,345	0,7	0,118	0,5	0,040	0,3	0,013	0,2	0,004	0,1										
0,40			5,499	2,5	1,868	1,6	0,574	1,0	0,196	0,6	0,066	0,4	0,022	0,2	0,010	0,2	0,003	0,1								
0,50			8,236	3,1	2,786	2,0	0,854	1,2	0,290	0,8	0,097	0,5	0,032	0,3	0,014	0,2	0,004	0,1								
0,60					3,869	2,4	1,183	1,4	0,401	0,9	0,134	0,6	0,045	0,4	0,017	0,3	0,006	0,2								
0,70					5,112	2,8	1,558	1,7	0,528	1,1	0,176	0,7	0,058	0,4	0,022	0,3	0,007	0,2	0,003	0,1						
0,80					6,513	3,1	1,980	1,9	0,669	1,2	0,223	0,8	0,074	0,5	0,028	0,3	0,01	0,2	0,004	0,1						
0,90					8,071	3,5	2,448	2,2	0,826	1,4	0,275	0,9	0,091	0,6	0,034	0,4	0,012	0,2	0,005	0,2						
1,00							2,960	2,4	0,997	1,5	0,332	1,0	0,110	0,6	0,046	0,5	0,014	0,3	0,005	0,2	0,003	0,1				
1,20							4,117	2,9	1,382	1,8	0,459	1,2	0,152	0,7	0,061	0,5	0,019	0,3	0,007	0,2	0,004	0,2				
1,40							5,449	3,4	1,824	2,1	0,604	1,4	0,199	0,9	0,076	0,6	0,026	0,4	0,009	0,2	0,005	0,2				
1,60									2,322	2,5	0,767	1,6	0,253	1,0	0,095	0,7	0,032	0,4	0,012	0,3	0,007	0,2				
1,80									2,874	2,8	0,948	1,7	0,311	1,1	0,113	0,8	0,039	0,5	0,015	0,3	0,008	0,2				
2,00									3,48	3,1	1,145	1,9	0,376	1,2	0,136	0,8	0,047	0,5	0,018	0,4	0,010	0,3				
2,20									4,139	3,4	1,360	2,1	0,446	1,3	0,157	0,9	0,550	0,6	0,021	0,4	0,012	0,3				
2,40											1,591	2,3	0,521	1,5	0,183	1,0	0,066	0,6	0,025	0,4	0,013	0,3				
2,60											1,839	2,5	0,601	1,6	0,207	1,1	0,076	0,7	0,028	0,5	0,016	0,4				
2,80											2,104	2,7	0,686	1,7	0,236	1,1	0,086	0,7	0,033	0,5	0,018	0,4				
3,00											2,385	2,9	0,777	1,8	0,263	1,2	0,097	0,8	0,037	0,5	0,021	0,4				
3,20											2,682	3,1	0,873	2,0	0,295	1,3	0,111	0,8	0,042	0,6	0,022	0,4				
3,40											2,995	3,3	0,974	2,1	0,325	1,4	0,123	0,9	0,046	0,6	0,025	0,5				
3,60											3,324	3,5	1,08	2,2	0,36	1,4	0,135	0,9	0,052	0,6	0,028	0,5				
3,80													1,190	2,3	0,393	1,5	0,149	1,0	0,056	0,7	0,03	0,5				
4,00													1,306	2,4	0,432	1,6	0,165	1,1	0,062	0,7	0,034	0,5				
4,20													1,427	2,6	0,467	1,7	0,180	1,1	0,067	0,7	0,037	0,6				
4,40													1,553	2,7	0,509	1,7	0,195	1,2	0,074	0,8	0,041	0,6				
4,60													1,683	2,8	0,547	1,8	0,210	1,2	0,079	0,8	0,043	0,6				
4,80													1,819	2,9	0,592	1,9	0,226	1,3	0,086	0,8	0,047	0,7				
5,00													1,959	3,1	0,632	2,0	0,246	1,3	0,092	0,9	0,051	0,7				
5,20															0,680	2,0	0,264	1,4	0,100	0,9	0,053	0,7				
5,40															0,73	2,1	0,281	1,4	0,106	0,9	0,058	0,7				
5,60															0,775	2,2	0,300	1,5	0,114	1,0	0,062	0,8				
5,80															0,828	2,3	0,322	1,5	0,120	1,0	0,065	0,8				
6,00															0,875	2,3	0,342	1,6	0,129	1,1	0,069	0,8				
6,50															0,952	2,4	0,395	1,7	0,147	1,1	0,08	0,9				
7,00															1,154	2,7	0,451	1,8	0,169	1,2	0,092	1,0				
7,50															1,241	2,9	0,512	2,0	0,193	1,3	0,010	1,0				
8,00															1,399	3	0,575	2,1	0,217	1,4	0,116	1,1				
8,50																		0,642	2,2	0,240	1,5	0,130	1,2			
9,00																		0,713	2,4	0,267	1,6	0,145	1,2			
9,50																		0,786	2,5	0,296	1,7	0,160	1,3			
10,00																		0,864	2,6	0,326	1,8	0,174	1,4			
10,50																		0,944	2,7	0,353	1,8	0,191	1,4			
11,00																		1,028	2,9	0,386	1,9	0,208	1,5			
11,50																		1,122	3,0	0,419	2,0	0,226	1,6			
12,00																				0,450	2,1	0,243	1,6			
12,50																				0,486	2,2	0,262	1,7			
13,00																				0,524	2,3	0,282	1,8			
13,50																				0,563	2,4	0,303	1,8			
14,00																				0,598	2,4	0,321	1,9			
14,50																				0,639	2,5	0,342	2,0			
15,00																				0,681	2,6	0,366	2,0			
15,50																				0,725	2,7	0,389	2,1			
16,00																										

water temperature = 50 °C

	20 × 2,8 mm		25 × 2,8 mm		32 × 3,6 mm		40 × 4,5 mm		50 × 5,6 mm		63 × 7,1 mm		75 × 8,4 mm		90 × 10,1 mm		110 × 12,3 mm		125 × 14,0 mm	
Q	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v
l/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s
0,02	0,022	0,1	0,008	0,1																
0,04	0,075	0,2	0,026	0,2	0,008	0,1	0,003	0,1												
0,06	0,154	0,4	0,053	0,2	0,016	0,1	0,006	0,1	0,002	0,1										
0,08	0,257	0,5	0,088	0,3	0,027	0,2	0,009	0,1	0,003	0,1										
0,10	0,382	0,6	0,131	0,4	0,040	0,2	0,014	0,2	0,005	0,1	0,002	0,1								
0,12	0,530	0,7	0,181	0,5	0,056	0,3	0,019	0,2	0,006	0,1	0,002	0,1								
0,14	0,698	0,9	0,238	0,6	0,073	0,3	0,025	0,2	0,008	0,1	0,003	0,1								
0,16	0,888	1,0	0,302	0,6	0,093	0,4	0,032	0,2	0,011	0,2	0,004	0,1								
0,18	1,099	1,1	0,373	0,7	0,115	0,4	0,039	0,3	0,013	0,2	0,004	0,1	0,001	0,1						
0,20	1,330	1,2	0,450	0,8	0,138	0,5	0,047	0,3	0,016	0,2	0,005	0,1	0,002	0,1						
0,30	2,785	1,8	0,935	1,2	0,285	0,7	0,096	0,5	0,032	0,3	0,011	0,2	0,003	0,1	0,001	0,1				
0,40	4,731	2,5	1,578	1,6	0,478	1,0	0,161	0,6	0,054	0,4	0,018	0,2	0,005	0,2	0,002	0,1				
0,50	7,161	3,1	2,376	2,0	0,716	1,2	0,240	0,8	0,080	0,5	0,026	0,3	0,008	0,2	0,003	0,1				
0,60			3,325	2,4	0,997	1,4	0,334	0,9	0,110	0,6	0,036	0,4	0,011	0,3	0,005	0,2				
0,70			4,425	2,8	1,322	1,7	0,441	1,1	0,146	0,7	0,048	0,4	0,014	0,3	0,006	0,2	0,002	0,1		
0,80			5,675	3,1	1,689	1,9	0,562	1,2	0,185	0,8	0,061	0,5	0,018	0,3	0,008	0,2	0,003	0,1		
0,90			7,073	3,5	2,098	2,2	0,696	1,4	0,229	0,9	0,075	0,6	0,023	0,4	0,010	0,2	0,004	0,2		
1,00					2,549	2,4	0,843	1,5	0,277	1,0	0,091	0,6	0,028	0,5	0,011	0,3	0,004	0,2	0,002	0,1
1,20					5,677	2,9	1,118	1,8	0,285	1,2	0,126	0,7	0,037	0,5	0,015	0,3	0,006	0,2	0,003	0,2
1,40					4,770	3,4	1,565	2,1	0,510	1,4	0,166	0,9	0,050	0,6	0,021	0,4	0,008	0,2	0,004	0,2
1,60							2,004	2,5	0,650	1,6	0,211	1,0	0,063	0,7	0,026	0,4	0,010	0,3	0,006	0,2
1,80							2,494	2,8	0,807	1,7	0,261	1,1	0,079	0,8	0,032	0,5	0,012	0,3	0,007	0,2
2,00							3,036	3,1	0,980	1,9	0,316	1,2	0,094	0,8	0,039	0,5	0,015	0,4	0,008	0,3
2,20							3,629	3,4	1,168	2,1	0,376	1,3	0,113	0,9	0,046	0,6	0,017	0,4	0,010	0,3
2,40									1,372	2,3	0,441	1,5	0,131	1,0	0,055	0,6	0,021	0,4	0,011	0,3
2,60									1,592	2,5	0,511	1,6	0,153	1,1	0,063	0,7	0,023	0,5	0,013	0,4
2,80									1,828	2,7	0,585	1,7	0,174	1,1	0,072	0,7	0,027	0,5	0,015	0,4
3,00									2,079	2,9	0,664	1,8	0,199	1,2	0,081	0,8	0,030	0,5	0,017	0,4
3,20									2,345	3,1	0,748	2,0	0,222	1,3	0,093	0,8	0,035	0,6	0,017	0,4
3,40									2,627	3,3	0,837	2,1	0,250	1,4	0,103	0,9	0,038	0,6	0,021	0,5
3,60									2,925	3,5	0,930	2,2	0,275	1,4	0,114	0,9	0,043	0,6	0,023	0,5
3,80											1,028	2,3	0,306	1,5	0,125	1,0	0,047	0,7	0,025	0,5
4,00											1,131	2,4	0,334	1,6	0,139	1,1	0,047	0,7	0,027	0,5
4,20											1,239	2,6	0,368	1,7	0,152	1,1	0,056	0,7	0,031	0,6
4,40											1,351	2,7	0,399	1,7	0,164	1,2	0,062	0,8	0,034	0,6
4,60											1,468	2,8	0,435	1,8	0,178	1,2	0,066	0,8	0,036	0,6
4,80											1,589	2,9	0,469	1,9	0,192	1,3	0,073	0,8	0,039	0,7
5,00											1,716	3,1	0,508	2,0	0,209	1,3	0,077	0,9	0,042	0,7
5,20													0,544	2,0	0,224	1,4	0,084	0,9	0,045	0,7
5,40													0,586	2,1	0,239	1,4	0,089	0,9	0,048	0,7
5,60													0,623	2,2	0,255	1,5	0,096	1,0	0,052	0,8
5,80													0,669	2,3	0,275	1,5	0,102	1,0	0,054	0,8
6,00													0,716	2,3	0,292	1,6	0,109	1,1	0,058	0,8
6,50													0,826	2,4	0,338	1,7	0,125	1,1	0,067	0,9
7,00													0,95	2,7	0,388	1,8	0,144	1,2	0,078	1,0
7,50													1,083	2,9	0,441	2,0	0,164	1,3	0,087	1,0
8,00													1,225	3,0	0,497	2,1	0,185	1,4	0,098	1,1
8,50															0,556	2,2	0,205	1,5	0,111	1,2
9,00															0,618	2,4	0,229	1,6	0,123	1,2
9,50															0,684	2,5	0,254	1,7	0,137	1,3
10,00															0,753	2,6	0,280	1,8	0,149	1,4
10,50															0,824	2,7	0,304	1,8	0,163	1,4
11,00															0,900	2,9	0,333	1,9	0,178	1,5
11,50															0,984	3,0	0,362	2,0	0,194	1,6
12,00																	0,390	2,1	0,208	1,6
12,50																	0,422	2,2	0,225	1,7
13,00																	0,455	2,3	0,243	1,8
13,50																	0,489	2,4	0,261	1,8
14,00																	0,521	2,4	0,277	1,9
14,50																	0,557	2,5	0,297	2,0
15,00																	0,595	2,6	0,317	2,0
15,50																	0,634	2,7	0,337	2,1
16,00																	0,669	2,8	0,359	2,2
16,50																	0,711	2,9	0,378	2,2
17,00																	0,753	3,0	0,400	2,3
17,50																			0,423	2,4
18,00																			0,447	2,4
18,50																			0,468	2,5
19,00																			0,493	2,6
19,50																			0,518	2,6
20,00																			0,544	2,7
20,50																			0,567	2,8
21,00																			0,594	2,8
21,50																			0,622	2,9
22,00																			0,651	3,0

water temperature = 80 °C

	20 × 2,8 mm		25 × 2,8 mm		32 × 3,6 mm		40 × 4,5 mm		50 × 5,6 mm		63 × 7,1 mm		75 × 8,4 mm		90 × 10,1 mm		110 × 12,3 mm		125 × 14,0 mm	
Q	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v	R	v
l/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s	kPa/m	m/s
0,02	0,019	0,1	0,007	0,1																
0,04	0,067	0,2	0,023	0,2	0,007	0,1	0,002	0,1												
0,06	0,134	0,4	0,047	0,2	0,013	0,1	0,005	0,1	0,002	0,1										
0,08	0,221	0,5	0,074	0,3	0,023	0,2	0,008	0,1	0,003	0,1										
0,10	0,328	0,6	0,111	0,4	0,034	0,2	0,011	0,2	0,004	0,1	0,001	0,1								
0,12	0,465	0,7	0,155	0,5	0,048	0,3	0,016	0,2	0,006	0,1	0,002	0,1								
0,14	0,612	0,9	0,206	0,6	0,064	0,3	0,021	0,2	0,008	0,1	0,003	0,1								
0,16	0,777	1,0	0,263	0,6	0,082	0,4	0,028	0,2	0,01	0,2	0,003	0,1								
0,18	0,976	1,1	0,327	0,7	0,097	0,4	0,034	0,3	0,011	0,2	0,004	0,1	0,001	0,1						
0,20	1,180	1,2	0,397	0,8	0,119	0,5	0,041	0,3	0,013	0,2	0,004	0,1	0,002	0,1						
0,30	2,492	1,8	0,828	1,2	0,247	0,7	0,083	0,5	0,027	0,3	0,009	0,2	0,003	0,1	0,001	0,1				
0,40	4,299	2,5	1,406	1,6	0,419	1,0	0,139	0,6	0,047	0,4	0,015	0,2	0,005	0,2	0,002	0,1				
0,50	6,536	3,1	2,129	2,0	0,631	1,2	0,212	0,8	0,700	0,5	0,023	0,3	0,007	0,2	0,003	0,1				
0,60			3,018	2,4	0,885	1,4	0,293	0,9	0,095	0,6	0,032	0,4	0,010	0,3	0,004	0,2				
0,70			4,030	2,8	1,180	1,7	0,388	1,1	0,127	0,7	0,042	0,4	0,013	0,3	0,005	0,2	0,002	0,1		
0,80			5,183	3,1	1,530	1,9	0,501	1,2	0,164	0,8	0,053	0,5	0,016	0,3	0,007	0,2	0,003	0,1		
0,90			6,513	3,5	1,907	2,2	0,621	1,4	0,200	0,9	0,065	0,6	0,020	0,4	0,009	0,2	0,003	0,2		
1,00					2,323	2,4	0,761	1,5	0,244	1,0	0,079	0,6	0,025	0,5	0,010	0,3	0,004	0,2	0,002	0,1
1,20					3,277	2,9	1,062	1,8	0,346	1,2	0,109	0,7	0,034	0,5	0,014	0,3	0,005	0,2	0,003	0,2
1,40					4,389	3,4	1,423	2,1	0,457	1,4	0,148	0,9	0,045	0,6	0,019	0,4	0,007	0,2	0,004	0,2
1,60							1,835	2,5	0,583	1,6	0,188	1,0	0,057	0,7	0,024	0,4	0,009	0,3	0,005	0,2
1,80							2,281	2,8	0,731	1,7	0,233	1,1	0,071	0,8	0,029	0,5	0,011	0,3	0,006	0,2
2,00							2,792	3,1	0,888	1,9	0,282	1,2	0,085	0,8	0,035	0,5	0,013	0,4	0,007	0,3
2,20							3,354	3,4	1,067	2,1	0,34	1,3	0,103	0,9	0,041	0,6	0,016	0,4	0,009	0,3
2,40									1,253	2,3	0,399	1,5	0,119	1,0	0,050	0,6	0,019	0,4	0,01	0,3
2,60									1,465	2,5	0,462	1,6	0,140	1,1	0,057	0,7	0,021	0,5	0,011	0,4
2,80									1,68	2,7	0,529	1,7	0,159	1,1	0,065	0,7	0,025	0,5	0,013	0,4
3,00									1,91	2,9	0,607	1,8	0,182	1,2	0,074	0,8	0,027	0,5	0,015	0,4
3,20									2,167	3,1	0,684	2	0,203	1,3	0,084	0,8	0,031	0,6	0,017	0,4
3,40									2,426	3,3	0,765	2,1	0,229	1,4	0,094	0,9	0,035	0,6	0,019	0,5
3,60									2,715	3,5	0,85	2,2	0,253	1,4	0,104	0,9	0,039	0,6	0,021	0,5
3,80											0,947	2,3	0,282	1,5	0,114	1,0	0,042	0,7	0,023	0,5
4,00											1,042	2,4	0,308	1,6	0,127	1,1	0,047	0,7	0,025	0,5
4,20											1,14	2,6	0,34	1,7	0,139	1,1	0,051	0,7	0,028	0,6
4,40											1,244	2,7	0,368	1,7	0,151	1,2	0,056	0,8	0,031	0,6
4,60											1,36	2,8	0,403	1,8	0,163	1,2	0,060	0,8	0,032	0,6
4,80											1,492	2,9	0,434	1,9	0,176	1,3	0,066	0,8	0,035	0,7
5,00											1,589	3,1	0,471	2,0	0,192	1,3	0,071	0,9	0,038	0,7
5,20													0,504	2,0	0,206	1,4	0,077	0,9	0,041	0,7
5,40													0,544	2,1	0,221	1,4	0,081	0,9	0,044	0,7
5,60													0,585	2,2	0,235	1,5	0,088	1,0	0,047	0,8
5,80													0,622	2,3	0,254	1,5	0,093	1,0	0,05	0,8
6,00													0,666	2,3	0,270	1,6	0,100	1,1	0,053	0,8
6,50													0,77	2,4	0,313	1,7	0,115	1,1	0,062	0,9
7,00													0,888	2,7	0,36	1,8	0,132	1,2	0,071	1,0
7,50													1,013	2,9	0,409	2,0	0,151	1,3	0,080	1,0
8,00													1,147	3,0	0,462	2,1	0,171	1,4	0,090	1,1
8,50															0,517	2,2	0,189	1,5	0,102	1,2
9,00															0,576	2,4	0,212	1,6	0,113	1,2
9,50															0,638	2,5	0,235	1,7	0,126	1,3
10,00															0,703	2,6	0,259	1,8	0,137	1,4
10,50															0,771	2,7	0,282	1,8	0,151	1,4
11,00															0,842	2,9	0,309	1,9	0,165	1,5
11,50															0,922	3,0	0,337	2,0	0,180	1,6
12,00																	0,362	2,1	0,192	1,6
12,50																	0,393	2,2	0,209	1,7
13,00																	0,424	2,3	0,225	1,8
13,50																	0,456	2,4	0,242	1,8
14,00																	0,486	2,4	0,257	1,9
14,50																	0,52	2,5	0,276	2,0
15,00																	0,556	2,6	0,295	2,0
15,50																	0,593	2,7	0,314	2,1
16,00																	0,627	2,8	0,334	2,2
16,50																	0,666	2,9	0,352	2,2
17,00																	0,706	3,0	0,373	2,3
17,50																			0,395	2,4
18,00																			0,417	2,4
18,50																			0,437	2,5
19,00																			0,460	2,6
19,50																			0,485	2,6
20,00																			0,509	2,7
20,50																			0,531	2,8
21,00																			0,557	2,8
21,50																			0,583	2,9
22,00																			0,610	3,0

6.

DISTRIBUTION SYSTEMS OF DRINKING WATER, COLD AND HOT WATER

6.1. PIPING MAINS

- The assembly is performed, based on the project documentation which complies to the valid standards EN 806-1 – 3.
- Method of installation of piping and its protection should be designed properly so that no pressure is transferred to the piping from the construction structures.
- The piping should be as short and straight as possible.
- It is not possible to install in parallel the mains of drinking water and the piping of central heating in channels that are inaccessible for person.
- Water mains laid in constructional structures must be permanently secured against freezing, and the thermal characteristics of the object outside sheathing should not be impaired by the piping installation. The failure of the piping must not endanger the object.
- Water mains must not pass through chimney flues.
- Mains for drinking water must not pass through spaces with increased concentration of the vapors from oil products (PHM stores).
- Piping of an internal water distribution system may be laid in the ground under floor of constructional object only when it is laid in a protective structure with the possibility of check (in protective tube, in an installation channel etc.)

Covered pipeline

- Concealed pipes stored in protective pipes or insulation must be conducted in an installation shaft or grooves in the walls, respectively in a properly conducted ducts in the floor.
- When the pipe is placed in protective tubes or in insulation into the building structure (eg. In concrete floors or walls), it is necessary to ensure that there can be no deformation or displacement.
- Protective pipes in ceilings must be completed at least 30 mm higher than the finished floor level, to prevent any possible leak of liquid spills.
- Thermal expansion pipe is in plastic pipes maintained in protective pipes secured by suitable fastening but is water and the protective pipe at the point of exit from the wall of floor.

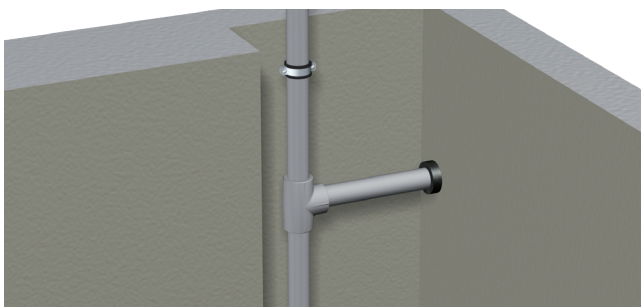
Connecting piping

- The connecting piping should be oriented in places without any assumed mechanical damage by drilling or cutting during fixing of supports, brackets, mirrors, handrails etc.
- Each intake armature must be fixed firmly, either with use of a wall-mounted structure in a classic masonry structure or with use of fixing elements for the attachment to walls of the service duct in flats.
- Attaching of pipes may be carried out using similar method as at attachment of cables by special clamps. It is necessary to insert a separation inserts from felt, foam, rubber, polyethylene etc. between pipes and clamps, which will prevent rubbing of pipes during dilatation movements, and protecting the pipe against mechanical damage in the place of attachment, or it is possible to use special metal clamps with rubber insert. It is necessary to use the separation insert of plastic clamps are used.
- For the fixing of the pipes, it is not recommended to use metal hooks as these may damage the pipes when the hooks are driven in the masonry.
- For the grooves in masonry, it is recommended to use pipes made with even shape, because a pipe from coil retains its shape memory. Fixing of pipes in grooves is made by plaster through a thermal insulation of protective part.
- Determination of places for laying of piping is carried out according to the projecting documentation and with observance of the specified pipe slopes. If the slope degree is not determined in the documentation, the piping is mounted with slope min 0,3 % towards the discharge or outlet armatures.

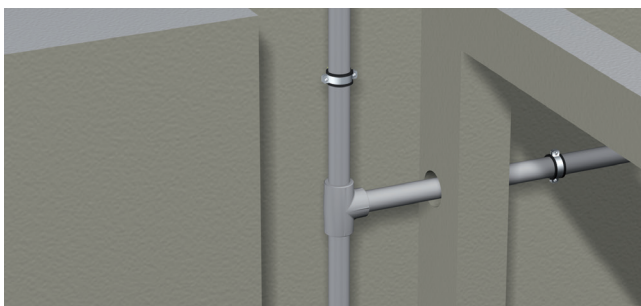
Vertical piping

- A branch from vertical piping to the connection piping is made indirectly by an elbow creating a flexible bending arm between the vertical and the connecting piping. By this adjustment an efficient compensation of dilatation or plastic mains is reached (see pict. 3). In the pict. 1 and 2 are shown other possible alternatives, i.e. a long arm of free passing through the wall.
- The vertical piping must be equipped with compensation elements.
- The vertical piping must be equipped with a system of fixed and sliding gripping located in dependence on the applied compensation elements (see the project documentation, chapter 7 of this manual).

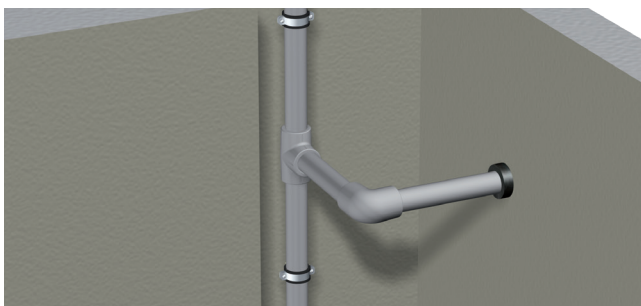
- Gripping of vertical piping may be performed by the existing clips equipped with plastic protection or by plumber clamps with a rubber insert.
- Each passing through the constructional structure (ceiling spaces) must be equipped with suitable plastic bushing (polyethylene pipe, PVC pipe etc.) so that the plastic piping is not in a direct contact with the constructional structure (pict. 4).
- From the point of view of fire, it is necessary to fill the space between the rising pipe and gland with a non-flammable mastic (prevention of chimney effect).
- The vertical piping must be equipped with an independent closing armature.
- The vertical piping must be connected to horizontal distribution system with elimination of influences caused by its own weight of vertical piping and influences caused by thermal changes.



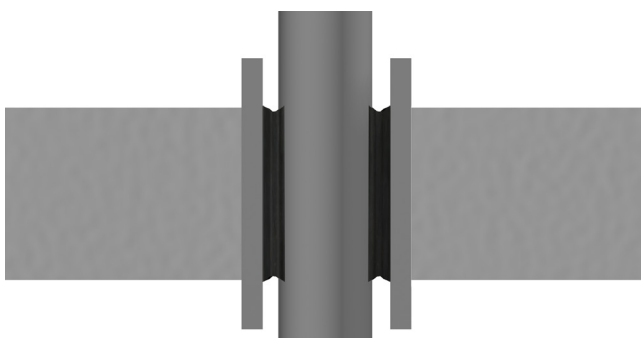
pic. 1



pic. 2



pic. 3



pic. 4

Horizontal distribution

- The horizontal distribution may be laid on benches under ceiling in grooves in masonry, in channels in floor, in gutters in soil or in plastic or metal sheets troughs. It is not recommended to fix the plastic pipes to the original steel mains.
- The horizontal distribution, as well as vertical piping, must be equipped with compensation elements of the fixed and sliding systems, which will assure the correct function of compensators.
- The closing armatures for the individual vertical piping (sections) must be oriented in accessible areas for the case of necessary quick closing.

Piping slope

- Horizontal piping must be installed with slope min. 0,3 % towards the lowest point of possible drainage and towards the highest point for ventilation.
- It is recommended that the horizontal mains of cold water are with slope towards the water connection (to the water metering set with a discharge armature). The horizontal distribution systems of hot water and circulation piping should have the slope towards the hot water reservoir.
- Parts of horizontal piping which cannot be ventilated to the vertical piping must be equipped with an independent vent valve located at the highest point. Piping parts that cannot be drained by discharges must be equipped with an independent discharge armature.

6.2. DISTANCE OF SUPPORTS

In case of when the piping is laid on surface of walls or installed under ceilings, it is necessary to observe the correct pitch at the supports or attachments.

In the following tables you can always find the maximum distance of supports for individual pipes and PP-R/PP-RCT system INSTAPLAST.

PP-R S5 (PN10)

Ø piping [mm]	Supports distance [cm]	
	20 °C	30 °C
20	80	75
25	85	85
32	100	95
40	110	110
50	125	120
63	140	135
75	155	150
90	165	165
110	185	180

PP-R S3,2 (PN16)

Ø piping [mm]	Supports distance [cm]					
	20 °C	30 °C	40 °C	50 °C	60 °C	80 °C
20	90	80	80	80	70	65
25	95	95	95	90	80	75
32	110	105	105	100	95	80
40	120	120	115	105	100	95
50	135	130	125	120	115	100
63	155	150	145	135	130	115
75	170	165	160	150	145	125
90	180	180	170	165	160	135
110	200	195	190	180	175	155

PP-R S2,5 (PN20)

Ø piping [mm]	Supports distance [cm]					
	20 °C	30 °C	40 °C	50 °C	60 °C	80 °C
20	95	90	85	85	80	70
25	100	100	100	95	90	85
32	120	115	115	110	100	90
40	130	130	125	120	115	100
50	150	150	140	130	125	110
63	170	160	155	150	145	125
75	185	180	175	160	155	140
90	200	200	185	180	175	150
110	220	215	210	195	190	165

UNIBETA

Ø piping [mm]	Supports distance [cm]					
	20 °C	30 °C	40 °C	50 °C	60 °C	80 °C
16	80	75	75	70	70	60
20	85	80	75	75	70	65
25	90	90	90	85	80	75
32	105	100	100	95	90	80
40	115	115	110	105	100	90
50	130	125	120	115	110	95
63	145	140	135	130	125	110
75	160	155	150	140	135	120
90	170	170	160	155	150	130
110	190	185	180	170	165	145
125	205	200	190	185	180	160
160	210	200	190	180	170	155
200	245	235	225	215	205	190

CARBO^{CRP}

Ø piping [mm]	Supports distance [cm]
	Independently of the water temperature
20	80
25	100
32	110
40	120
50	130
63	145
75	150
90	155
110	160
125	165

Spacing supports for vertical pipes acc. to the above table may be multiplied by a factor of up to 1.3m i.e. greater spacing than the horizontal piping. Here it is necessary to proceed from the disposition acc. to the facts and options location of fixed and sliding, as well as consultations with the designer.

7.

COMPENSATION OF PLASTIC PIPING

Due to the differences in temperature during assembly of piping, and the respective operation, the expansion of piping may occur (or shrinkage). Magnitude of this longitudinal change depends on the length of piping, coefficient of linear expansion and the differences in temperature.

Table for comparison of coefficients of linear expansion

Pipe	α (mm/(m.K))
PP-R	0,150
UNIBETA	0,150
CARBO ^{CRP}	0,045

Expansion properties of the pipes - Linear expansion formula

$$\Delta L = \alpha \times L \times \Delta T$$

- ΔL elongation [mm]
 α thermal coefficient of expansion
 L length of pipe during installation [m]
 ΔT temperature difference when installing and operating temperatures [K]

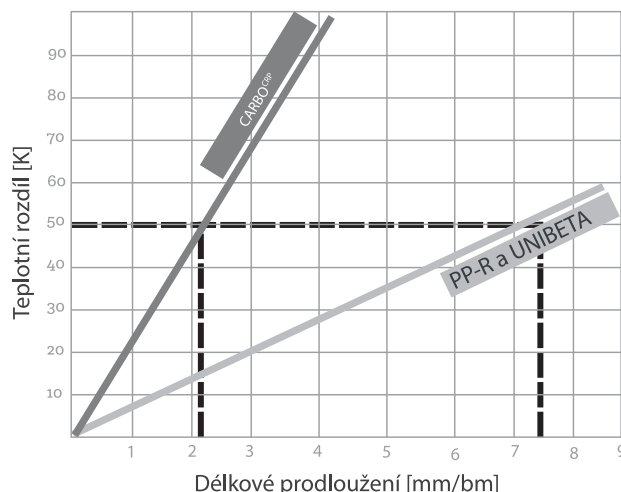
Examples

PP-R: $\Delta L = 0,15 \cdot 6 \cdot 50 = 45$ mm

- t_m installing temperature 15 °C
 t_p operating temperature hot water 65 °C
 L piping length 6 m
 α 0,15 mm/(m.K)
 where $\Delta t = t_p - t_m$

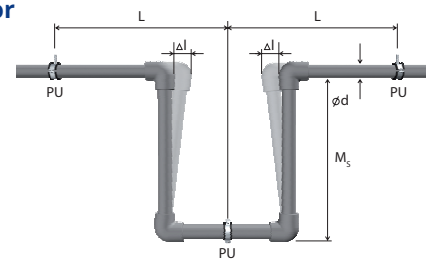
CARBO^{CRP}: $\Delta L = 0,045 \cdot 6 \cdot 50 = 13,5$ mm

- t_m installing temperature 15 °C
 t_p operating temperature hot water 65 °C
 L piping length 6 m
 α 0,045 mm/(m.K)



The calculated linear expansion may be compensated by a suitable compensator:

a) U - compensator



- PU - fixed fit
 L - pipe length
 Δl - elongation
 $\varnothing d$ - pipe diameter
 M_s - extension

The length of the flexible arm M_s depends on the expansion and the pipe diameter.

$$M_s = k \cdot \sqrt{\Delta l \cdot d}$$

- k material constant (PP-R $k = 20$)
 Δl elongation (mm)
 d piping diameter (mm)

$$M_s = 20 \cdot \sqrt{45 \cdot 32} = 758 \text{ mm}$$

Conclusion:

If PP-R piping with dimension 32 mm and length 6 meters is heated, it is extended by 45 mm. For the compensation of this expansion, a flexible arm must be used with minimum length 758 mm. Correct function of a compensator is depends on the suitable location of fixed and sliding fits.

b) L – compensator

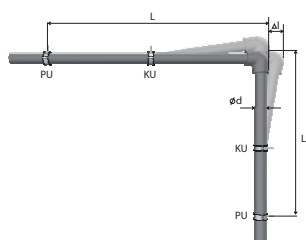
PU - fixed fit

KU - sliding fit

L - pipe length

Δl - elongation

$\varnothing d$ - pipe diameter



c) Dilatation loop

PU - fixed fit

KU - sliding fit

L - pipe length

$\varnothing d$ - pipe diameter

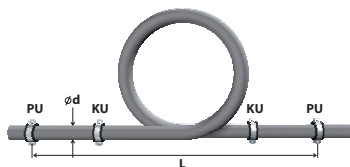


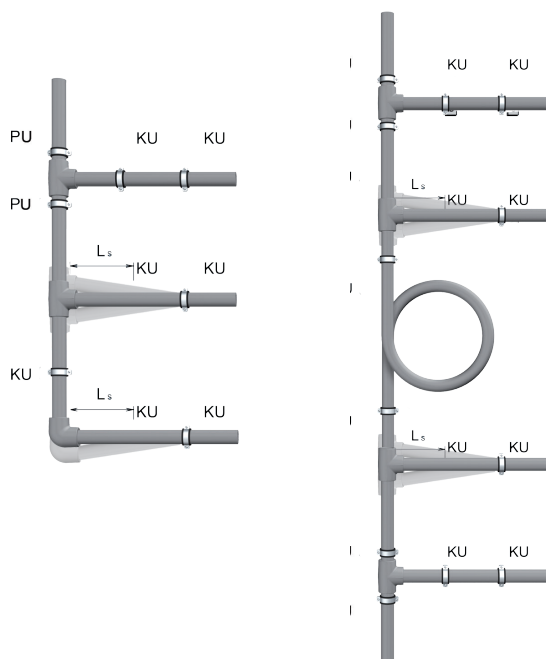
Table of extensions transferred by the dilatation loop:

d [mm]	max. Δl (mm)
16	90
20	80
25	70
32	55
40	45

Fixed fit - gripping, where the piping cannot dilate. This may be carried out, e.g. at the bent piping (pic. 1), at a branch (pic. 2) or at a place of a fitting or water meter (pic. 3).

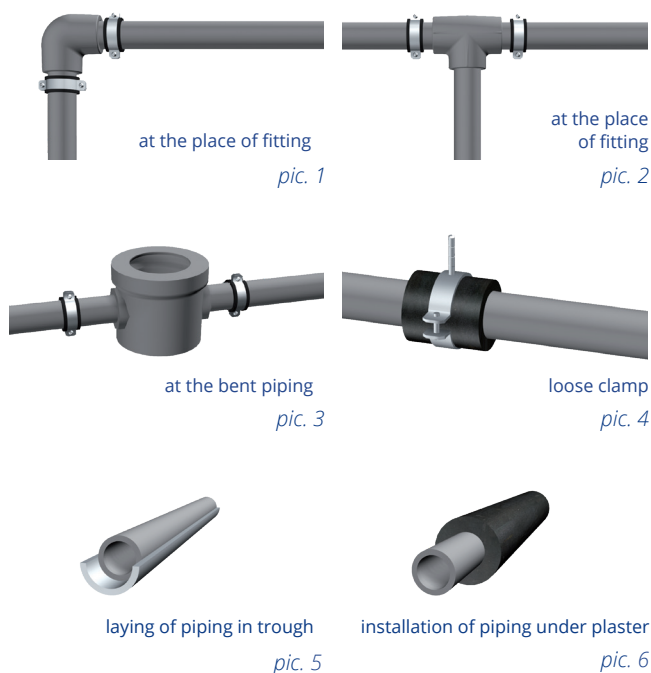
Sliding fit - method of fixing where the piping cannot move from the mains axis, however it can move and dilate axially inside a loose clamp (pic. 4), laying of piping in a trough (pic. 5) and installation under plaster with use of an insulation (pic. 6).

Ascending pipe line



Notice: These above given compensators may be used either for horizontal or for vertical piping. However in case of installation of plastic pipes under plaster, it is not possible to use these compensators. Linear expansion is in this case compensated by waving of piping.

It is necessary to take in mind the dilation also at the connected mains. In the ascending shafts at branches of connecting piping, it must be assured that this piping can accommodate to the changes in length of the ascending pipe, i.e. that it can dilate sufficiently (see the picture in chapter Ascending piping). Compensation of linear expansion of piping is an important factor for the correct function of plastic mains. If the piping cannot extend and shrink, additional tensile or pressure strains are concentrated in the piping walls which shorten dramatically the piping lifetime.



8.

ASSESSMENT AND REPAIRS OF THE SYSTEM

Installation is based on TNI CEN / TR 12 108. Before installing the necessary control external and within the limits of possibility and the inner surface of the tube. For pressure application can be used only undamaged components can not use tubes with damage exceeding 1/10 of the wall thickness.

8.1. PIPING CONNECTION

- The plastic piping from PP-R and PP-RCT system INSTAPLAST is connected by welding, it is also possible to use mechanical method of connecting with use of flanged connections in specific cases, in transitions to metal piping with threaded transition pieces (DG-transition pieces). The piping cannot be glued.
- The plastic mechanical couplings which may be also used for transitions of various plastic materials; it is necessary to ask the manufacturer to provide the Declaration about suitability of use for cold or hot water and the allowed max. pressures of media.
- Reduction of piping is made strictly by formed pieces determined for this purpose, it is prohibited to modify or change the existing formed pieces with using of any method.
- Bending at the mains are made with use of formed pieces.
- For the connection and repairs of pipes, it is possible to use welding methods by electroforming, whereas the electro-formed piece must be weldable with the given piping.
- Use of plastic pipes for hot water downwards of a through-flow water heater or the reservoir-type water heater is possible only at regulated heating systems where the medium temperature does not exceed in a long term 60 °C at max. operation pressure 10,9 bar at tube S2,5 (PN20) and in a short term 70 °C at max. operation pressure 8.3 bar at tube S2,5 (PN20).

Sealing of threaded transition pieces

1. It is prohibited to use hemp with respect to the necessary high tightening torque and the possibility of tearing the metal injection out of the plastic material; at the internal injections, there exists the risk of metal cracking.
2. It is allowed to use PTFE tape, special textile tapes (+GF ± Paraliq) or mastics based on PTFE which must be applied acc. to recommendations and manufacturer's instructions. The used sealing materials must be tested according to valid legislation and standards.

8.2. WELDABILITY OF MATERIALS

Weldability of plastic materials is assessed according to the weldability class as determined by the index of melt flow of the respective material - IT (MFR).

1. **Guaranteed weldability:** The materials have the same weldability class and IT are overlapping.
2. **Conditional weldability:** The materials have the same weldability class and IT are not overlapping, whereas the manufacturer guarantees their reciprocal weldability.

Warning: The index values of flow which are given in chapter 1.6. are valid for polypropylene material. Other combinations of materials (e.g. polypropylene - polyethylene) are basically unweldable. In such cases, it is necessary to use other connecting method.

8.3. POLYFUSION WELDING

Similar procedure of preparation and polyfusion welding of pipes of plastic materials is involved in the program of professional training courses for welders organized in compliance with the valid standards, unified methodology of welding of plastic materials and the Technical rules of Czech welding association ANB.

- **Course Z - u/7** - basic course for installers by polyfusion welding - 4 days
- **Course Z - u/V** - basic course for welding of external and internal distribution systems from plastic materials by various methods, including gluing - 10 days
- **Course C - u/V** - a course with certification test

8.3.1. TOOLS AND ACCESSORIES

The welding equipment for polyfusion welding is selected acc. to the diameter of welded piping and the character of welding works.

- up to diameter 40 mm (included) - Input 500 W Polys P - 1b
- up to diameter 63 mm (included) - Input 650 W Polys P - 1a, Polys P - 4/650 thorn-type
- up to diameter 75 mm (included) - Input 850 W Polys P - 4/850
- up to diameter 110 mm (included) - Input 1200 W Polys P - 4/1200 s

The individual polyfusion welding machines have (acc. to their design) the following options: the continuous analog regulation of temperature, continuous electronic regulation, or by steps by switching over to the required temperature. Also welding machines with one set temperature are manufactured.

Welding machines and fixtures are used from diameter 40 mm and higher:

- Fixture MP - 75 from Ø 40 mm to 75 mm (a corresponding welding machine must be used in compliance with the piping diameter used)
- Fixture MP - 110 from Ø 63 to 110 mm (welding machine 850 W and extensions in the fixture set)
- Welding machine ST - 160 from Ø 40 mm to 90 mm (welding machine 1200 W with extensions in the machine accessories - possibility of butt welding up to Ø 160 mm)

Polyfusion extensions may be jaw-type, or split extensions are used, acc. to the type of welding equipment, however all are provided with PTFE layer on the active surface which prevents sticking of plastic material to the heated up smelting surface.

Cutters and cutting equipment for plastic piping are manufactured in various sizes, acc. to the diameter of piping; cutters with cutting moment divided in to multiplied compression.

Cleaning paper for the surfaces on formed pieces and pipe should be without fibers and not colored (it is possible to use toilet paper). Also special single-use cleaning tissues containing isopropyl alcohol are suitable, which are compressed in sealing foil against drying up.

Cleaning agent for pipes and formed pieces used for cleaning of welded surfaces from mechanical or chemical impurities before welding. Cleaning agent Tangit is suitable, or isopropyl alcohol, or 96 % alcohol, respectively. It is not allowed to use for cleaning the petrol based liquids, organic solvents, or cleaning agents containing traces of these chemicals, respectively. Scale, marker and knife - we recommend to use this tools for measuring and marking of length for inserting of pipe in the formed piece, and smoothing of burrs before welding.

8.3.2. PRINCIPLE AND PROCEDURE OF POLYFUSION WELDING

A polyfusion weld is created by the simultaneous heating of cone throat of formed piece and the tube end in highly plastic state, and pressing the pipe in the throat of the formed piece in plastic state, fixing and cooling down of the connection, through which a homogeneous connection is created with high stiffness.

In the cold state, the formed piece must not allow sliding on to the pipe of the same dimension. The harder the from piece goes on pipe, the better the resulting connection.

During the welding, it is necessary to maintain, additionally to others, the basic parameters of welding: **Temperature, Pressure, Time**. Maintaining of these parameters will influence the quality and longevity of the weld.

Temperature of welding: welding temperature for PP-R and PP-RCT (PP type 3 and 4) 260 °C.

Pressure: conic design of the formed piece and polyfusion extensions will ensure the pressure of heated up materials and complete bonding of macromolecular chains.

Time: time necessary for production of weld, divided in phases as given in the table for the individual diameters.

8.3.3. PROCEDURE FOR THE POLYFUSION WELDING

1) Generally

Connecting of plastic parts is done by polyfusion welding, butt welding and welding by electroforming. It is necessary to follow exact procedure and use the suitable tools.

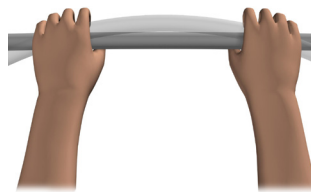
- For the assembly, it is possible to use only elements that are not damaged or polluted.
- Welding of elements PP-R/PP-RCT system INSTAPLAST may be performed at temperature min +5 °C (pic. 1).



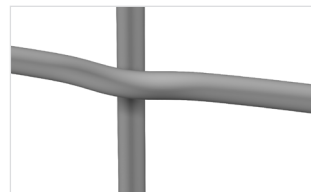
pic. 1



pic. 2

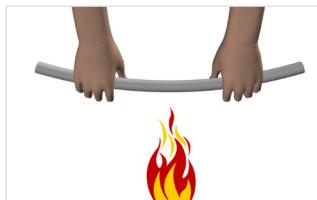


pic. 3

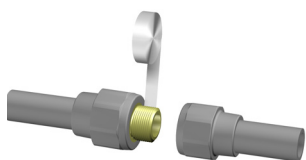


pic. 4

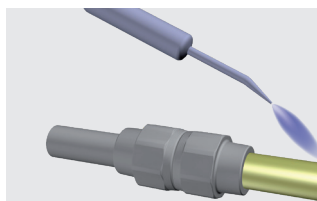
- The connected parts should be tempered at least 1 hour before the welding to the same temperature as it is specified in the work procedure.
- During the time of transport, handling and assembly, the system elements PP-R/PP-RCT system INSTAPLAST should be protected against shocks and other possible mechanical damage (pic. 2).
- Bending of pipes is performed without heating up at temperature min. +15 °C (pic. 3).
- Crossing of pipes is performed with use of special elements (pic. 4).
- It is not allowed to bend the pipes with use of hot air or open flame!!! (pic. 5).
- Threaded formed pieces are used for threaded connections. It is not admissible to cut threads directly on pipes!!! Sealing of threads is made by PTFE tape, sealing thread based on PTFE or by special sealing mastics (pic. 6). **It is prohibited to use hemp for sealing of threaded connections!!!**
- In cases where a metal pipe continues behind the formed piece, it is not possible to connect this piece by soldering or welding in the vicinity of the formed piece, with respect to the possible heat transfer in the formed piece!!! (pic. 7)



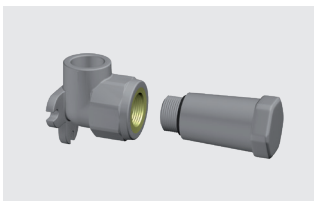
pic. 5



pic. 6



pic. 7



pic. 8

- During the pressure test, we recommend to use special mounting plastic plugs for closing of branches (wall-mounted structures, wall-mounted assemblies) (pic. 8).

2) Preparation

Fix the relevant welding extensions to the welding equipment, set the corresponding temperature by the regulator and plug in. In the heated state, using a cleaning cloth from non-synthetic textile material, clean the active surface from the rests of previous welding. The welding may be started after the welding equipment is heated up sufficiently.

Measure the necessary length of tube and cut it off (pic. 9).



pic. 9

Clean and degrease pipe active surface - throats of formed pieces and tube parts for sliding in the throat.

3) Heating

At first, slide the formed piece on a heated extension and check for proper gripping at the extension. Formed piece which does not have the contact with the extension over the whole surface should be rejected because an uneven heating would cause a weld with poor quality. After the formed piece, slide the the pipe on the extension.

For the tightness of sliding in, the same is valid as for the formed piece (pic. 10, pic. 11).



pic. 10



pic. 11

Heat up both parts during the time specified in the table. The heating time is measured from the time when both, the formed piece and the pipe, are slid on the welding extension over the whole length. During sliding in, it is

allowed to rotate slightly both parts (max. by 10°), before complete sliding over the required length. During the heating up, any rotation with the pipe or the formed piece is not allowed, to avoid any deformations of material.

**Table of welding for PP-R and PP-RCT (MRS8)
(with use of DVS 2207, part 1, for temperature 260 °C)**

Diameter [mm]	Heating time [sec]	Displacement time [sec]	Time of setting the weld [min]
16	5	3	2
20	5	3	2
25	7	3	2
32	8	6	4
40	12	6	4
50	18	6	4
63	24	8	6
75	30	8	6
90	40	8	6
110	50	10	8
125	60	90	8
160/200	butt welding at 210 °C		

DO NOT EXCEED THE HEATING TIME!

4) Displacement, connection and cooling down (setting)

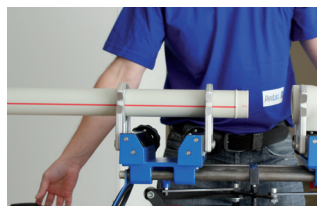
After the heating time remove pipe and formed piece from the heating extension and connect them. Slide the pipe by a slow even pressure without rotation in the throat of formed piece up to the measured length of sliding in (pict. 12, 13, 14 and 15). The table contents the maximum allowed time from removing from extension up to the sliding of pipe in the formed piece, i.e. time during which the fresh connection should be completed before it is cooled down partially, and the setting time of welds at the individual diameters.



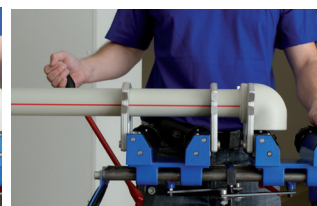
pic. 12



pic. 13



pic. 14



pic. 15

WARNING: after the cooling phase is finished (setting), the equilibrium condition is not achieved in the connection. The connection must be cooled down naturally before the first filling with cold water (permanent mechanical load) within this specified minimum time from the last welding:

- diameters 16, 20, 25 and 32 mm - 60 minutes
- diameters 40, 50, 63 and 75 mm - 90 minutes
- diameters 90, 110, 125, 160 and 200 mm - 120 minutes

8.4. PIPING REPAIRS

When applying plastic materials, it is not possible to avoid damages caused by unprofessional assembly, unqualified performance of welding operations, damages caused by external influence during the lifetime of the mains, e.g. mechanical damage (drilling in, cutting through, piercing etc.), or unexpected change of operation conditions (increase in temperature and/or pressure of media in the distribution system). Due to this facts, a damage of piping can occur, which is manifested by cracking or other destruction of a part of mains. To restore the correct function, it is necessary to carry out professional repair of the distribution system. The scope of repairs depends on the rate of damage. In majority of cases, the damage of mains is of local nature, and because the connection is not demountable, it can be repaired by cutting off of the damaged part and its replacement. Repairs with use of gluing must be excluded for majority of polyolefin materials owing to limited ability for gluing and complexity of technology.

In practice, the repair is made in the simplest way, i.e. by cutting out and welding on of a new part with use of suitable formed pieces. This method is used the most, but at the same time, it is also time consuming and requires extensive constructional works even by smaller damages.

Up to date, the electroformed pieces are used for these kinds of repairs. This method is using basically the plastic formed pieces which have a resistance wire coiled inside and terminated by two contacts determined for the connection to welding machine.

The weld itself is performed inside the connection: pipe - formed piece. This connection has several advantages:

- Only small space is necessary to complete this connection which is decreasing the constructional works to minimum.
- For polypropylene, it is possible to create the connection at temperature up to +5 °C (provided that the manufacturer does not require different temperature range).
- The technology decreases the probability of failure caused by human factor

During the use of electroformed pieces, the differences in comparison to polyfusion welding should be noted. Each worker should be trained in DU/8 course, as the minimum, or should pass the courses ZU/V, CU/V. A closer explanation is given in the frame procedure of welding which in no case can replace the professional training.

8.5. ADDITIONAL INSTALLATION OF THE WELD IN SADDLE

A wide range of weld in saddles allows you to create a branch in diameter 20 - 63 mm or branch with internal and external thread (up to dim 2") for all types of PP-R/PP-RCT pipes of the INSTAPLAST system in diameters 63 - 200 mm.

By installing the saddle, the T-piece can be replaced and subsequently reduced to the required one branch dimension.

Welding is polyfusion - type C. For each diameter of the branch pipe is a special welding tool attachment, it is universal for all types flat welders. Welding takes place at a temperature of 260 °C (with permitted tolerance ± 10 °C). Welding tools must be clean and should be cleaned before each welding process.

- 1) Drill a hole with a special drill for a given diameter of pipe and saddle.
- 2) Clean this hole. and the saddle, degrease it.
- 3) Slide the weld in saddle onto the tool so that they follow each other lines on the seat and extension. Heat the hole and the welding saddle. Time warm-up for saddles: 90 x 32 mm is 8 s, for saddles 110 x 32 and 110 x 40 is 12 s, and for the other saddles 30 seconds.
- 4) Slide the heated saddle into the heated hole and fix for approx. 15 s. After one hour, it can be filled with water and subjected to pressure.

8.6. WELDING BY ELECTRO-FORMING

1) Preparation of material

- Adjust the pipe length using the cutter of wheel cutter.
- The pipe ends determined for sliding in the formed piece should be scraped, so that the oxidized layer is removed (approx. 0,1 mm). Then the formed piece and pipes are cleaned by cleaning agent.
- Select the piece for electroforming with a suitable diameter and from the identical material as the pipe. The pipe should be inserted easily in the formed piece (otherwise the tube must be scrapped more).

2) Procedure of the welding

- Assemble both connected parts and fix (by special yoke or otherwise), so that the tube is not extruded from the formed piece due to internal stress during welding.
- For the welding process itself, use a suitable welding equipment (e.g. welding equipment DYTRON), and connect it to power source and wait until the required working mode is set. After setting of required parameters connect the adapters to the contacts on the formed piece and start the welding process. completion of welding is signaled by the control lamp on the welding equipment.
- When the weld is made correctly, the control points are marked on the formed piece.
- The connection must not be stressed mechanically during 60 - 120 min. (depending on the formed piece) from the time of completion of weld.

8.7. WORKING CONDITIONS

The working place and working areas must comply with safety regulations. The working spaces must have sufficient lighting, be protected against wind, ideally with a roof against rain and solar radiation, with such manipulation and storage conditions which can prevent any mechanical damage of plastic materials. In winter period, the working place and the structure where the welding procedures of piping routes or the preparation of prefabricates will be performed, should be heated. Welding of elements of PP-R/PP-RCT system INSTAPLAST system (with exception of pieces made by electroforming) may be performed from ambient temperature + 5 °C; for the preparation of prefabricates, it is recommended to warm up the working space to min. + 10 °C. The connected parts should be tempered at least 1 hour before the welding to the same temperature in a heated working space.

Composition of working group:

- Installer - welder • Installer - helper

9.

PRESSURE TEST

After finishing the assembly, and before connecting to public water mains or an own water resource, the internal water distribution system must be checked visually and pressure tested (see ČSN 73 6660). A record is made of the pressure test in compliance with the relevant regulations. The test of piping verifies its completeness, resistance to internal overpressure and tightness.

Before the pressure test, it is necessary to flush all sections of the internal water distribution system by water to sludge at the lowest point at the same time. The pressure test is performed after the assembly of all accessories, installation objects, appliances.

and equipment (outlet and safety armatures, pumps, heaters etc.). The internal water distribution system is tested by 1,5 multiple of the operation overpressure, however at least with overpressure 1,5 MPa. After filling with water, the internal water distribution system should be stabilized by operation overpressure min. during 12 hours. After this time, the pressure is increased to the value of test overpressure. After one hour from the time when the testing overpressure was reached, the pressure must not decrease by more than 0,02 MPa. When the decrease is higher, the pressure test is not compliant.

Example of record of the inspection and pressure test of an internal water mains acc. Czech norm

Protocol of pressure test performed on:

1. Name of the building object:
2. Construction site – address:
3. Water resources:
4. Project:
Changes of project:
5. Installed dimensions and lengths of piping:
6. Installed armatures:
7. Procedure of pressure test - pressure equipment:
start: end:
- test pressure: pressure after 1 hour:
- pressure decrease:
- result of the test:
- results of respective partial pressure tests:
8. Investor:
9. Supplier:

.....
Stamp & signature

.....
Stamp & signature

10.

CONNECTION OF THE INTERNAL WATER SUPPLY AND THE ELECTRICAL PROTECTIVE CONDUCTOR DEVICE

Water system is connected to the protective guidance of heavy equipment according to CSN 33 2000-4-41 ed. 2 and CSN 33 2000-5-54 ed. 3.

Protection against electric shock in bathrooms, lavatories and showers must comply with CSN 33 2000-7-701 ed. 2.

Bridging the water meter fitted on a conductive water pipe, which is connected to the protective conductor of the electrical equipment must be in accordance with the CSN 33 2000-4-41 ed. 2 and CSN 33 2000-5-54 ed. 3.

If the repair of water pipes replaced part of conductive material, it is still necessary before the interruption in the pipeline this part of the bridge that while working to prevent electric shock.

If the pipe between the conductive material is non-conductive pipe material (plastic) must be some continuity of grounding and equipotential bonding according to CSN 33 2000-5-54 ed. 3.

11.

INSULATION OF PIPING

- Internal water mains must not be installed in areas where the temperature during normal operation decreases under 5 °C, provided that the distribution system is not secured against the influences by temperature decrease (e.g. by insulation).
- Piping of cold water (installed loosely, laid in grooves in installation channels etc.) must be secured against condensation of moisture.
- Piping for cold water installed loosely in warm or heated environment, and installed in parallel with the heating system or the system of hot circulation water, must be protected against warming up and propagation of undesirable germs.
- Piping of hot water and circulation piping with forced circulation of water must be thermally insulated because of the thermal losses and linear expansion, in compliance with the requirements of valid standards.
- It is possible to use various materials for the insulation, e.g. foam, expanded polystyrene, mineral wool, or the insulation based on foam PE, PP or PUR, respectively. Minimum thickness of insulating layer is 5 mm for cold water. The minimum thickness of insulation layer for hot water is intended by Czech notice 193/2007. It depends on pipe diameter, wall thickness, insulation material and determining the heat transfer coefficient.
- Insulation pipes must be installed with pre-tension according to the instructions by the manufacturer because it is necessary to take in mind the natural shrinkage at the expanded materials - in longitudinal direction.

Determining the heat transfer coefficient insulated pipeline interior wiring $U_o \leq$ minimum requirement for thermal heat transfer coefficient per unit length U

Diameter [mm]	U [W/(m.k)]
DN 10 - DN 15	0,15
DN 20 - DN 32	0,18
DN 40 - DN 65	0,27
DN 80 - DN 125	0,34
DN 150 - DN 200	0,40

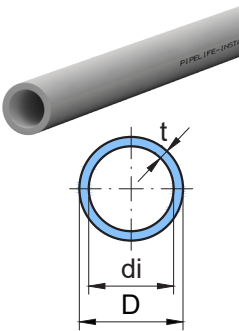
E.g. for pressure range of PN 20 is the minimum insulation thickness internal distribution in mm:

Diameter d [mm]	Stone wool	Mineral wool
	(Thermal Conductivity $\lambda_{iz} = 0,041 \text{ W/(m.K)}$)	(Thermal Conductivity $\lambda_{iz} = 0,038 \text{ W/(m.K)}$)
16	30	18
20	25	22
25	32	28
32	42	37
40	25	22
50	32	28
63	40	36
75	35	30
90	40	36
110	50	45
125	61	55
160	63	57

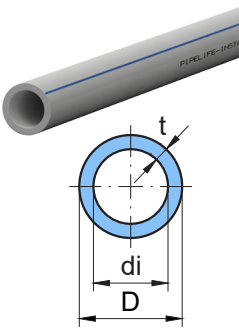
12.

SORTIMENT

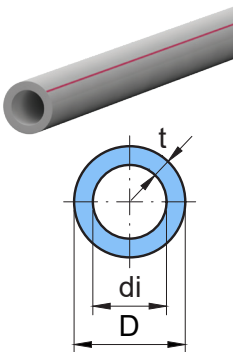
PIPES

PP-R S5	D (mm)	di (mm)	t [mm]	Code	SP	LP	kg/m
	20	16,2	1,9	3296400012	4	100	0,107
	25	20,4	2,3	3296401005	4	100	0,164
	32	26,2	2,9	3296401015	4	40	0,261
	40	32,6	3,7	3296402003	4	40	0,412

Pipes are available in rods 4 m length without stripe

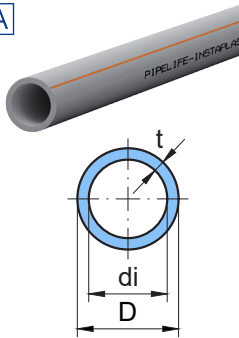
PP-R S3,2	D (mm)	di (mm)	t [mm]	Code		SP		LP		kg/m
				2 m	4 m	2 m	4 m	2 m	4 m	
	20	14,4	2,8	3296400024	3296400013	2	4	50	100	0,148
	25	18	3,5	3296401025	3296401006	2	4	50	100	0,23
	32	23,2	4,4	3296401026	3296401016	2	4	20	40	0,37
	40	29	5,5	-	3296402004		4		40	0,575

Pipes are available in rods 3 and 4 m length with blue stripe

PP-R S2,5	D (mm)	di (mm)	t [mm]	Code	SP	LP	kg/m
	20	13,2	3,4	3296400014	4	100	0,172
	25	16,6	4,2	3296401007	4	100	0,266
	32	21,2	5,4	3296401017	4	40	0,434
	40	26,6	6,7	3296402005	4	40	0,671

Pipes are available in rods 4 m length with red stripe


D - Outer diameter of the pipe; di - Inner diameter of the pipe; t - Pipe wall thickness; Code - Order code; S - pressure line; SP - Small pack; LP - Large pack
 ☎ +420313030914, +420313030916

UNIBETA (PP-RCT)	D (mm)	di (mm)	t [mm]	S	Code		SP		LP		kg/m
					3 m	4 m	3 m	4 m	3 m	4 m	
	16	13,8	2,2	3,2	3296430003	3296430002	3	4	75	100	0,091
	20	15,4	2,3	4	3296430006	3296430005	3	4	75	100	0,122
	25	19,4	2,8	4	3296431003	3296431002	3	4	75	100	0,185
	32	24,8	3,6	4	3296431007	3296431006	3	4	30	40	0,304
	40	31	4,5	4	3296432003	3296432002	3	4	30	40	0,474
	50	38,8	5,6	4	3296432007	3296432006	3	4	12	16	0,736
	63	48,8	7,1	4	3296433003	3296433002	3	4	6	8	1,176
	75	58,2	8,4	4	–	3296433006	3	4	6	8	1,654
	90	69,8	10,1	4	–	3296433010	3	4	3	4	2,386
	110	85,4	12,3	4	–	3296434002	3	4	3	4	3,548
	G 125	97	14,0	4	–	3296434004	–	4	–	4	4,580
	G 160	130,8	14,6	5	–	3295404001	–	4	–	4	6,270
	G 200	163,6	18,2	5	–	3295404002	–	4	–	4	9,950

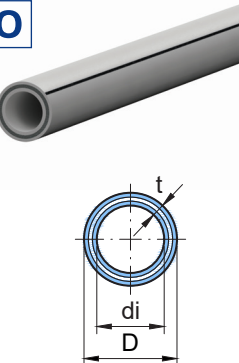
Pipes are available in rods 4 m length with orange stripe
G – Green color

UNIBETA (PP-RCT)	D (mm)	di (mm)	t [mm]	S	Code		SP		LP		kg/m
					2 m		2 m		2 m		
	20	15,4	2,3	4	3296430009		2		50		0,122
	25	19,4	2,8	4	3296431012		2		50		0,185
	32	24,8	3,6	4	3296431013		2		20		0,304

Pipes are available in rods 2 m length with orange stripe

UNIBETAPLUS (PP-RCT)	D (mm)	di (mm)	t [mm]	S	Code		SP		LP		kg/m
					2 m	4 m	2 m	4 m	2 m	4 m	
	20	14,4	2,8	3,2	3296430013	3296430014	2	4	50	100	0,144
	25	18	3,5	3,2	3296431016	3296431017	2	4	50	100	0,23
	32	23,2	4,4	3,2	3296431018	3296431019	2	4	20	40	0,37

Pipes are available in rods 2 and 4 m length with blue green stripe


CARBO ^{CRP} (PP-RCT/PP-RCT+CF/PP-RCT)	D (mm)	di (mm)	t [mm]	S	Code		SP		LP		kg/m
					3 m	4 m	3 m	4 m	3 m	4 m	
	20	14,4	2,8	3,2	3296410003	3296410002	3	4	75	100	0,145
	25	18	3,5	3,2	3296411003	3296411002	3	4	75	100	0,226
	32	23,2	4,4	3,2	3296411006	3296411005	3	4	30	40	0,364
	40	29	5,5	3,2	3296412003	3296412002	3	4	30	40	0,568
	50	36,2	6,9	3,2	3296412006	3296412005	3	4	12	16	0,887
	63	45,8	8,6	3,2	3296413003	3296413002	3	4	6	8	1,396
	75	58,2	8,4	4	–	3296413005	3	4	6	8	1,672
	90	69,8	10,1	4	–	3296413008	3	4	3	4	2,412
	110	85,4	12,3	4	–	3296414002	3	4	3	4	3,587
	G 125	97	14,0	4	–	3296414004	–	4	–	4	4,630

Pipes are available in rods 3 and 4 m length with blue black stripe
G – Green color

CARBO	D (mm)	di (mm)	t [mm]	S	Code		SP		LP		kg/m
					2 m		2 m		50		
	20	14,4	2,8	3,2	3296410005		2		50		0,145
	25	18	3,5	3,2	3296411009		2		50		0,226

FITTINGS


Elbow 45°



Type	d (mm)			Code	SP	LP	kg/pcs
16	15,5			3297440203	50	200	0,008
20	19,5			3297440210	50	500	0,019
25	24,5			3297441205	50	300	0,023
32	31,5			3297441214	20	100	0,036
40	39,4			3297442203	5	25	0,060
50	49,4			3297442210	5	20	0,101
63	62,5			3297443203	5	20	0,208
75	74,9			3297443210	2	8	0,402
90	89,9			3297443216	1	6	0,685
110	110,0			3297444202	1	5	1,025
G 125	125,0			3295414201	1	1	1,410
G 160	160,0	BUTT WELDED		3295414202	1	1	2,420
G 200	200,0	BUTT WELDED		3295414005	1	1	4,400

G - Green color


Elbow 90°



Type	d (mm)			Code	SP	LP	kg/pcs
16	15,5			3297440204	50	250	0,008
20	19,5			3297440211	50	400	0,013
25	24,5			3297441206	50	300	0,021
32	31,5			3297441215	20	100	0,038
40	39,4			3297442204	10	60	0,062
50	49,4			3297442211	10	30	0,102
63	62,5			3297443204	5	20	0,212
75	74,9			3297443211	2	6	0,513
90	89,9			3297443217	1	6	0,774
110	110,0			3297444203	1	4	1,025
G 125	125,0			3295414203	1	1	1,410
G 160	160,0	BUTT WELDED		3295414204	1	1	2,420
G 200	200,0	BUTT WELDED		3295414205	1	1	4,400


G - Green color

Elbow 45° with pin



Type	d (mm)	D (mm)		Code	SP	LP	kg/pcs
20	19,5	20,0		3297440213	20	200	0,011
25	24,5	25,0		3297441219	20	200	0,017

Elbow 90° with pin



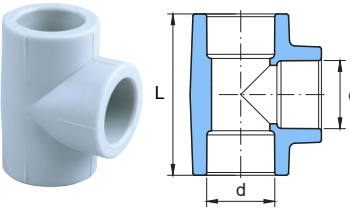
Type	d (mm)	D (mm)		Code	SP	LP	kg/pcs
20	19,5	20,0		3297440212	50	300	0,015
25	24,5	25,0		3297441207	50	250	0,031
32	31,5	32,0		3297441220	20	100	0,063

Elbow 90° reduced

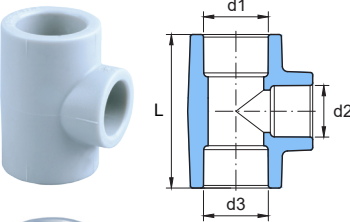
Type	d1 (mm)	d2 (mm)		Code	SP	LP	kg/pcs
25x20	24,5	19,5		3295411203	1	1	0,03

Code - Order code; S - pressure line; SP - Small pack; LP - Large pack;

☎ +420313030914, +420313030916


T-piece	Type	d (mm)	L [mm]			Code	SP	LP	kg/pcs
	16	15,5	44,0			3297440303	50	250	0,012
	20	19,5	54,0			3297440312	50	300	0,023
	25	24,5	65,0			3297441310	50	150	0,036
	32	31,5	78,0			3297441330	20	100	0,065
	40	39,4	94,0			3297442305	10	50	0,121
	50	49,4	114,0			3297442322	5	30	0,212
	63	62,5	140,0			3297443304	2	16	0,459
	75	74,9	142,0			3297443314	1	6	0,527
	90	89,9	162,6			3297443319	1	6	0,944
	110	110,0	195,0			3297444301	1	4	1,506
G	125	125,0	248,0			3295414301	1	1	2,510
G	160	160,0	BUTT WELDED			3295414302	1	1	4,060
G	200	200,0	BUTT WELDED			3295414303	1	1	7,300

G - Green color

T-piece reduced	Type	d1 [mm]	d2 [mm]	d3 [mm]	L [mm]	Code	SP	LP	kg/pcs
	20x16x20	19,5	15,5	19,5	54,0	3297440313	50	300	0,026
	20x25x20	19,5	24,5	19,5	64,0	3297440314	50	150	0,034
	25x20x25	24,5	19,5	24,5	60,0	3297441311	50	200	0,029
	25x25x20	24,5	24,5	19,5	64,0	3297441312	50	150	0,038
	25x32x25	24,5	31,5	24,5	76,0	3297441313	20	120	0,049
	25x20x20	24,5	19,5	19,5	60,0	3297441314	10	100	0,035
	32x20x32	31,5	19,5	31,5	69,0	3297441331	20	100	0,045
	32x20x25	31,5	19,5	24,5	69,0	3297441332	20	100	0,047
	32x25x32	31,5	24,5	31,5	70,0	3297441333	20	100	0,054
	32x32x25	31,5	31,5	24,5	77,0	3297441334	20	100	0,061
	32x40x32	31,5	39,4	31,5	89,0	3297441335	10	50	0,081
	40x20x40	39,4	19,5	39,4	78,0	3297442306	10	60	0,073
	40x25x40	39,4	24,5	39,4	81,0	3297442307	10	60	0,108
	40x32x40	39,4	31,5	39,4	90,0	3297442308	10	50	0,123
	50x25x50	49,4	24,5	49,4	80,0	3297442323	5	30	0,151
	50x32x50	49,4	31,5	49,4	80,0	3297442324	5	30	0,146
	50x40x50	49,4	39,4	49,4	114,0	3297442325	5	30	0,149
	63x32x63	62,5	31,5	62,5	92,0	3297443306	5	20	0,267
	63x40x63	62,5	39,4	62,5	92,0	3297443305	5	20	0,264
	63x50x63	62,5	49,4	62,5	140,0	3297443307	2	16	0,422
	75x50x75	74,9	49,4	74,9	142,0	3297443315	2	12	0,555
	75x63x75	74,9	62,5	74,9	142,0	3297443316	2	8	0,531
	90x63x90	89,9	62,5	88,9	136,0	3297443320	2	6	0,720
	90x75x90	89,9	74,9	88,9	148,0	3297443321	2	6	0,805
	110x63x110	110,0	62,5	110,0	148,0	3297444302	1	5	1,051
	110x75x110	110,0	74,9	110,0	160,0	3297444303	1	4	1,170
	110x90x110	110,0	89,9	110,0	175,0	3297444304	1	4	1,270
G	125x75x125	124,5	74,5	124,5	248,0	3295414304	1	1	2,320
G	125x90x125	124,5	74,5	124,5	248,0	3295414305	1	1	2,330
G	125x110x125	124,5	74,5	124,5	248,0	3295414306	1	1	2,400
G	160x90x160		BUTT WELDED			3295414307	1	1	3,520
G	160x110x160		BUTT WELDED			3295414308	1	1	3,650
G	200x90x200		BUTT WELDED			3295414319	1	1	6,170
G	200x110x200		BUTT WELDED			3295414320	1	1	6,280
G	200x125x200		BUTT WELDED			3295414321	1	1	6,370
G	200x160x200		BUTT WELDED			3295414322	1	1	6,700


G - Green color

Three way branch




Type	d (mm)				Code	SP	LP	kg/pcs
20	19,5				3297440311	10	50	0,030
25	24,5				3295411302	1	1	0,035
32	31,5				3295411303	1	1	0,072
40	39,5				3295412301	1	1	0,122

Cross



Type	d1 (mm)	d2 (mm)			Code	SP	LP	kg/pcs
20	19,5	19,5			3297440315	25	100	0,022
25	24,5	24,5			3297441315	25	100	0,037
32	31,5	31,5			3297441336	10	50	0,065


Pipe coupling



Type	d (mm)	L [mm]			Code	SP	LP	kg/m
16	15,5	28,0			3297440402	50	250	0,006
20	19,5	30,0			3297440407	50	600	0,012
25	24,5	40,0			3297441406	50	400	0,018
32	31,5	46,0			3297441420	20	200	0,032
40	39,4	53,5			3297442406	20	100	0,050
50	49,4	62,0			3297442419	10	70	0,089
63	62,5	62,0			3297443405	5	30	0,161
75	74,9	71,5			3297443417	2	30	0,275
90	89,9	76,0			3297443424	1	16	0,423
110	110,0	90,0			3297444402	1	10	0,618
Z 125	125,0	90,0			3295414414	1	1	0,76

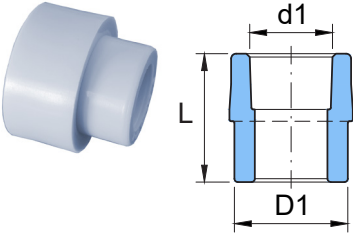
Z – zelená Color

Reducing pipe coupling



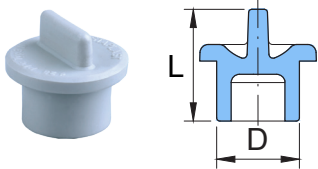
Type	d1 (mm)	d2 (mm)	L [mm]		Code	SP	LP	kg/pcs
20/16	19,5	15,5	30,0		3297440409	50	200	0,010
25/20	24,5	19,5	32,0		3297441408	50	450	0,017
32/20	31,5	19,5	39,0		3297441424	50	250	0,026
32/25	31,5	24,5	35,0		3297441423	50	250	0,025
40/32	39,4	31,5	40,0		3297442410	10	100	0,045
50/40	49,4	39,4	46,0		3297442422	10	90	0,078
63/50	62,5	49,4			3295413404	1	1	0,085

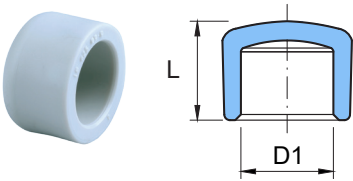
A reducing pipe coupling socket is used to connect pipe to pipe.

Reduction	Type	D1 (mm)	d2 (mm)	L [mm]			Code	SP	LP	kg/pcs
	20/16	20	15,5	32,0			3297440408	50	250	0,006
	25/20	25	19,5	32,0			3297441407	50	500	0,010
	32/20	25	19,5	32,5			3297441421	50	250	0,013
	32/25	32	24,5	38,0			3297441422	50	300	0,017
	40/20	40	19,5	34,0			3297442407	10	100	0,020
	40/25	40	24,5	35,5			3297442408	10	100	0,021
	40/32	40	31,5	39,0			3297442409	20	100	0,028
	50/32	50	31,5	62,0			3297442420	10	100	0,043
	50/40	50	39,4	66,0			3297442421	10	100	0,058
	63/32	63	31,5	75,5			3297443406	10	70	0,063
	63/40	63	39,4	65,0			3297443407	10	70	0,087
	63/50	63	49,4	62,5			3297443408	10	60	0,102
	75/40	75	39,4	64,5			3295413403	1	1	0,120
	75/50	75	49,4	57,5			3297443419	2	20	0,122
	75/63	75	62,5	65,0			3297443418	1	25	0,178
	90/63	90	62,5	64,5			3295413401	1	1	0,210
	90/75	90	74,9	78,0			3295413402	1	1	0,270
	110/75	110	74,9	60,0			3295414410	1	1	0,480
	110/90	110	89,9	87,0			3295414411	1	1	0,500
G	125/110	125	BUTT WELDED				3295414402	1	1	1,050
G	160/110	160	BUTT WELDED				3295414403	1	1	1,150
G	160/125	160	BUTT WELDED				3295414404	1	1	1,160
G	200/110	200	BUTT WELDED				3295414417	1	1	1,100
G	200/160	200	BUTT WELDED				3295414418	1	1	2,610

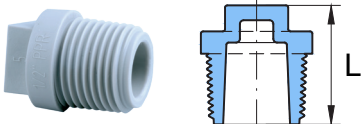
G - Green color

A reducer is used to connect the pipe to the fitting.

Plug	Type	L (mm)					Code	SP	LP	kg/pcs
	16	25,0					3297440604	50	200	0,003
	20	29,0					3297440612	50	300	0,006
	25	31,0					3297441606	50	200	0,009
	32	36,5					3297441613	10	100	0,014

Blinder	Type	d (mm)	L [mm]				Code	SP	LP	kg/m
	16	15,5	16,0				3297440603	50	400	0,004
	20	19,5	24,0				3297440611	50	200	0,008
	25	24,5	25,0				3297441605	50	200	0,013
	32	31,5	26,2				3297441612	10	100	0,026
	40	39,4	30,8				3297442603	5	50	0,040
	50	49,4	35,4				3297442607	5	30	0,074
	63	62,5	44,0				3297443602	5	25	0,149
	75	74,9	58,2				3297443605	5	20	0,257
	90	89,9	66,0				3297443606	2	6	0,364
	110	110,0	79,0				3297444601	2	8	0,602
G	125	125,0	87,0				3295414601	1	1	0,790
G	160	160,0	BUTT WELDED				3295414602	1	1	0,890
G	200	200,0	BUTT WELDED				3295414419	1	1	2,040

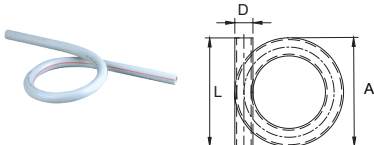
G - Green color


Plug with thread		Color	Type	L [mm]		Code	SP	LP	kg/pcs
	CW	blue	1/2"	24,0		3297440613	50	250	0,006
		red	1/2"	24,0		3297440614	50	250	0,006
		grey	1/2"	24,0		3297440615	50	250	0,006
		grey	3/4"	24,0		3297441607	50	500	0,009


CW - This product is for cold water only

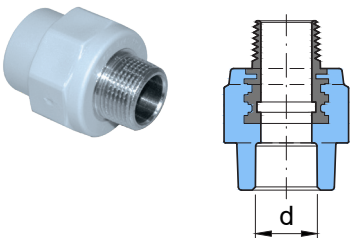
Plug with seal for pressure test		Color	Type	L [mm]		Code	SP	LP	kg/pcs
	CW	blue	1/2"	70,0		3297440617	10	250	0,021
		red	1/2"	70,0		3297440618	10	250	0,021
		grey	1/2"	70,0		3297440616	10	250	0,021

CW - This product is for cold water only

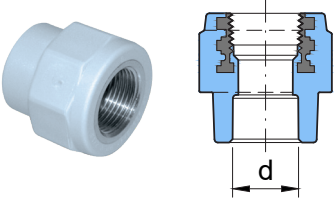
Crossing	Type	D (mm)	A (mm)	L [mm]	S	Code	SP	LP	kg/pcs
	32	32,0	210,0	450,0	2,5	3295441212	1	60	0,434

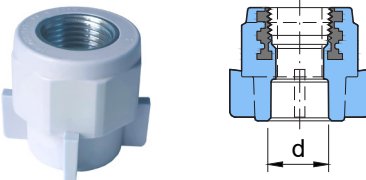
Socket crossing	Type	d (mm)	A (mm)	L [mm]		Code	SP	LP	kg/pcs
	20	19,5	53,0	184,0		3297440327	10	50	0,041
	25	24,5	60,0	184,0		3297440328	10	50	0,060

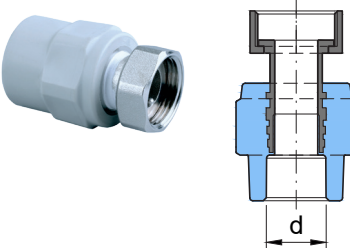
Socket crossing	Type	D (mm)	A (mm)	L [mm]	S	Code	SP	LP	kg/pcs
	20	20,0	45,0	400,0	2,5	3295440207	10	50	0,069
	25	25,0	50,0	400,0	2,5	3295441205	10	50	0,106
	32	32,0	70,0	400,0	2,5	3295441211	5	20	0,174
	20	20,0	45,0	400,0	3,2	3295440206	10	50	0,059
	25	25,0	50,0	400,0	3,2	3295441204	10	50	0,092
	32	32,0	70,0	400,0	3,2	3295441210	5	20	0,148

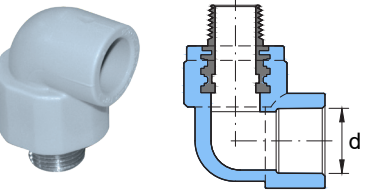
DG coupling MZV (male)	Type	d (mm)			Code	SP	LP	kg/pcs
	16x1/2"	15,5			3297450704	10	50	0,063
	20x1/2"	19,5			3297450714	10	150	0,067
	20x3/4"	19,5			3297450715	10	100	0,102
	25x1/2"	24,5			3297451710	10	100	0,068
	25x3/4"	24,5			3297451711	10	80	0,100
	32x3/4"	31,5			3297451729	5	50	0,110
	32x1"	31,5			3297451730	4	60	0,138
	40x5/4"	39,4			3297452702	4	20	0,280
	50x6/4"	49,4			3297452704	4	20	0,386
	63x2"	62,5			3297453702	2	12	0,666
	75x2,5"	74,9			3297453705	1	9	0,916
	90x3"	89,9			3297453707	1	6	1,676
G	110x4"	108,9			3295414701	1	1	2,890
G	125x5"	123,8			3295414702	1	1	4,380

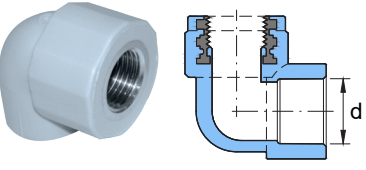
G - Green color

DG coupling MZD (female)	Type	d (mm)			Code	SP	LP	kg/pcs
	16x1/2"	15,5			3297450804	10	100	0,050
	20x1/2"	19,5			3297450822	10	200	0,051
	20x3/4"	19,5			3297450823	10	100	0,072
	25x1/2"	24,5			3297451812	10	100	0,052
	25x3/4"	24,5			3297451813	10	100	0,075
	32x3/4"	31,5			3297451832	5	40	0,084
	32x1"	31,5			3297451833	4	60	0,106
	40x5/4"	39,4			3297452802	4	20	0,359
	50x6/4"	49,4			3297452805	4	20	0,324
	63x2"	62,5			3297453802	2	12	0,564
	75x2,5"	74,9			3297453804	2	8	1,075
	90x3"	89,9			3297453805	1	6	1,600
	G 110x4"	108,9			3295414801	1	1	2,130
	G 125x5"	123,8			3295414703	1	1	3,510
G - Green color								

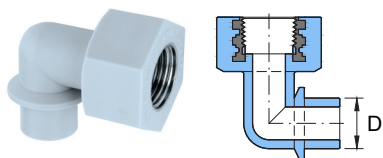
DG coupling MZV (female) cross	Type	d (mm)			Code	SP	LP	kg/pcs
	20x1/2"	19,5			3297450821	10	100	0,053

DG coupling with nut union	Type	d (mm)			Code	SP	LP	kg/pcs
	16x3/4"	15,5			3295440804	10	100	0,117
	20x1/2"	19,5			3295440819	10	100	0,097
	20x3/4"	19,5			3295440817	10	100	0,091
	20x1"	19,5			3295440818	10	50	0,167
	25x3/4"	24,5			3295441809	10	50	0,122
	25x1"	24,5			3295441808	10	40	0,173
	32x1"	31,5			3295441823	5	25	0,191
	32x5/4"	31,5			3295441822	5	50	0,270

Elbow 90° MZV (male)	Type	d (mm)			Code	SP	LP	kg/pcs
	16x1/2"	15,5			3297450705	10	100	0,069
	20x1/2"	19,5			3297450717	10	150	0,076
	20x3/4"	24,5			3297450718	10	50	0,104
	25x1/2"	19,5			3297451712	10	50	0,076
	25x3/4"	24,5			3297451713	10	100	0,112
	32x3/4"	31,5			3297451731	10	50	0,120
	32x1"	31,5			3297451732	5	50	0,153

Elbow 90° MZD (female)	Type	d (mm)			Code	SP	LP	kg/pcs
	16x1/2"	15,5			3297450803	10	100	0,054
	20x1/2"	19,5			3297450817	10	150	0,064
	20x3/4"	19,5			3297450818	10	100	0,066
	25x1/2"	24,5			3297451808	10	100	0,063
	25x3/4"	24,5			3297451809	10	100	0,084
	32x3/4"	31,5			3297451827	5	50	0,088
	32x1"	31,5			3297451828	5	50	0,130

Elbow 90°MZD (female) with pin	Type	D (mm)				Code	SP	LP	kg/pcs
	20x1/2"	20,0				3297450816	10	100	0,055




Elbow 90°with union nut	Type	d (mm)				Code	SP	LP	kg/pcs
	16x3/4"	15,5				3295440805	10	100	0,115
	20x3/4"	19,5				3295440820	10	50	0,129
	20x1"	19,5				3295440821	10	50	0,175
	25x3/4"	24,5				3295441811	10	50	0,121
	25x1"	24,5				3295441810	10	50	0,179
	32x1"	31,5				3295441825	5	50	0,196
	32x5/4"	31,5				3295441824	5	30	0,282

Wall piece MZD (female)	Type	d (mm)				Code	SP	LP	kg/pcs
	16x1/2"	15,5				3297450602	10	100	0,060
	20x1/2"	19,5				3297450610	10	150	0,062
	25x1/2"	24,5				3297451605	10	50	0,073
	25x3/4"	24,5				3297451606	10	100	0,084

Fixing plate for wall elbows	L (mm)	E1 (mm)	F1 (mm)	B (mm)	C (mm)	Code	SP	LP	kg/pcs
	240,0	100,0	150,0	44,0	9,2	3297470006	5	100	0,019

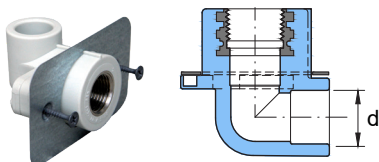


Suitable for fixing wall elbows 20x1/2" and 25x1/2"

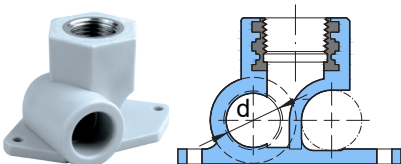


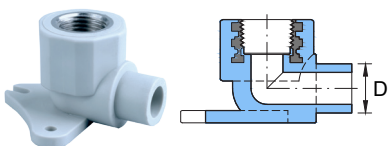
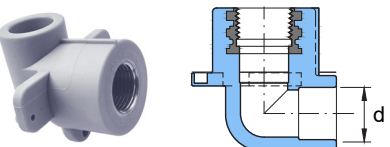
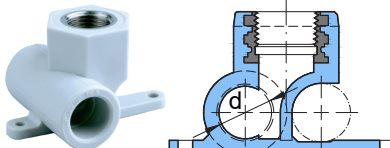
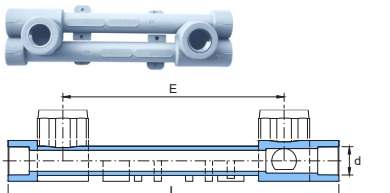
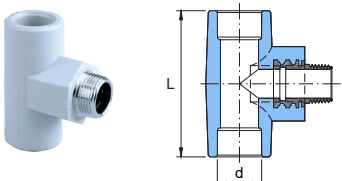
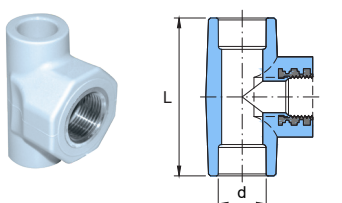
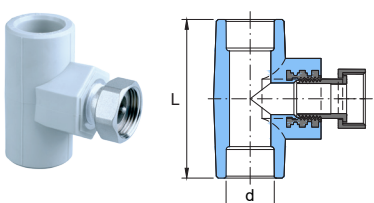
Set - Fixing plate and wall elbows	Type	Popis				Code	SP	LP	kg/set
	20x1/2"	2x wall piece MZD (female) + fixing plate for wall elbows				3295440605	2	20	0,286
	25x1/2"	2x wall piece MZD (female) + fixing plate for wall elbows				3295441603	2	20	0,330

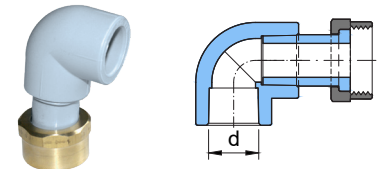
Wall piece MZD (female) for gypsum board	Type	d (mm)				Code	SP	LP	kg/pcs
	20x1/2"	19,5				3295440601	2	20	0,096



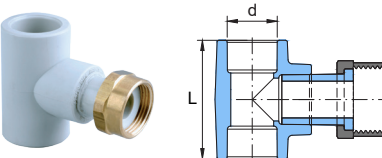
Terminal wall piece MZD (female) right, left	Type	d (mm)				Code	SP	LP	kg/pcs
	20x1/2" R	19,5				3297450612	10	100	0,067
	20x1/2" L	19,5				3297450613	10	100	0,096



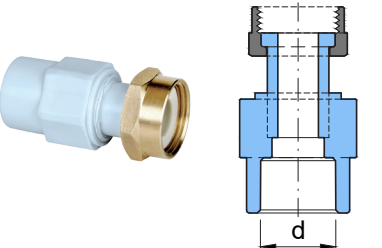
Wall piece MZD (female) with pin 	Type	D (mm)				Code	SP	LP	kg/pcs
	20x1/2"	20,0				3297450616	10	150	0,071
Partition wall piece MZD (female) 	Type	d (mm)				Code	SP	LP	kg/pcs
	20x1/2"	19,5				3297450615	10	100	0,070
Throught wall piece MZD (female) 	Type	d (mm)				Code	SP	LP	kg/pcs
	20x1/2"	19,5				3297450611	10	100	0,067
	25x1/2"	24,5				3297451604	5	50	0,085
Wall set MZD (female) 	Type	d (mm)	E (mm)	L [mm]		Code	SP	LP	kg/pcs
	20x1/2"	19,5	151,5	226,5		3297450614	2	10	0,210
T-piece MZV (male) 	Type	d (mm)	L [mm]			Code	SP	LP	kg/pcs
	20x1/2"	19,5	65,0			3297450713	10	100	0,080
	25x1/2"	24,5	68,0			3297451708	10	100	0,090
	25x3/4"	24,5	80,0			3297451709	5	20	0,148
	32x1/2"	31,5	68,0			3297451728	5	40	0,094
T-piece MZD (female) 	Type	d (mm)	L [mm]			Code	SP	LP	kg/pcs
	20x1/2"	19,5	66,0			3297450819	10	120	0,065
	20x3/4"	19,5	74,0			3297450820	5	30	0,084
	25x1/2"	24,5	76,0			3297451810	5	100	0,087
	25x3/4"	24,5	81,0			3297451811	5	25	0,110
	32x1/2"	31,5	68,0			3297451829	5	25	0,088
	32x3/4"	31,5	80,0			3297451830	5	25	0,104
	32x1"	31,5	86,0			3297451831	5	20	0,170
T-piece with union nut 	Type	d (mm)				Code	SP	LP	kg/pcs
	20x1/2"	19,5				3295440814	5	50	0,100
	20x3/4"	19,5				3295440815	10	100	0,138
	20x1"	19,5				3295440816	5	50	0,198
	25x3/4"	24,5				3295441806	5	50	0,150
	25x1"	24,5				3295441807	5	50	0,201
	32x3/4"	31,5				3295441819	5	40	0,154
	32x1"	31,5				3295441820	5	30	0,202

Elbow 90°Bj with union nut		Type	d (mm)			Code	SP	LP	kg/pcs
	CW	16x1/2"	15,5			3295440901	10	150	0,043
		20x1/2"	19,5			3295440908	10	100	0,049
		20x3/4"	19,5			3295440909	10	100	0,062
		25x3/4"	24,5			3295441904	10	100	0,070
		25x1"	24,5			3295441905	10	50	0,103

CW - This product is for cold water only

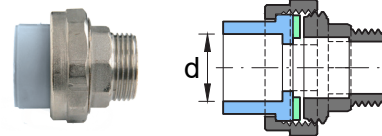
T-piece Bj with union nut		Type	d (mm)			Code	SP	LP	kg/pcs
	CW	16x1/2"	15,5			3295440902	10	60	0,036
		20x1/2"	19,5			3295440910	10	100	0,050
		20x3/4"	19,5			3295440911	5	50	0,058
		20x1"	19,5			3295440912	5	50	0,109
		25x3/4"	24,5			3295441906	5	50	0,066
		25x1"	24,5			3295441907	5	25	0,100
		32x3/4"	31,5			3295441909	5	25	0,082
		32x1"	31,5			3295441910	5	25	0,131

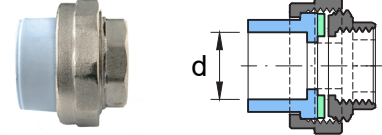
CW - This product is for cold water only


Coupling Bj with union nut		Type	d (mm)			Code	SP	LP	kg/pcs
	CW	20x1/2"	19,5			3295440905	10	100	0,036
		20x3/4"	19,5			3295440906	10	100	0,055
		25x3/4"	24,5			3295441901	10	100	0,060
		25x1"	24,5			3295441902	10	50	0,094
		32x1"	31,5			3295441908	5	30	0,102
		20x3/4" *	19,5			3295440907	10	100	0,051
		25x3/4"*	24,5			3295441903	10	100	0,060

*UN with seal hole


CW - This product is for cold water only

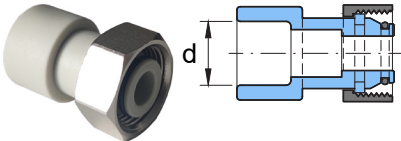
Transition union (male)		Type	d (mm)			Code	SP	LP	kg/pcs
		20x1/2"	19,5			3295410005	25	100	0,111
		20x3/4"	19,5			3295410006	25	75	0,157
		20x1"	19,5			3295410012	25	50	0,209
		25x3/4"	24,5			3295411008	25	75	0,180
		25x1"	24,5			3295411010	25	50	0,185
		32x1"	31,5			3295411009	25	50	0,202
		40x5/4"	39,4			3295412003	25	25	0,293
		50x6/4"	49,4			3295412004	10	20	0,413
		63x2"	62,5			3295413005	5	10	0,881
		75x2,5"	74,9			3295413006	5	5	1,016


Transition union (female)		Type	d (mm)			Code	SP	LP	kg/pcs
		20x1/2"	19,5			3295410003	25	100	0,093
		20x3/4"	19,5			3295410004	25	75	0,150
		20x1"	19,5			3295410013	25	50	0,160
		25x3/4"	24,5			3295411005	25	75	0,147
		25x1"	24,5			3295411007	25	50	0,165
		32x1"	31,5			3295411006	25	50	0,189
		40x5/4"	39,4			3295412005	25	25	0,241
		50x6/4"	49,4			3295412006	10	20	0,388
		63x2"	62,5			3295413007	5	10	0,767
		75x2,5"	74,9			3295413008	5	5	0,980

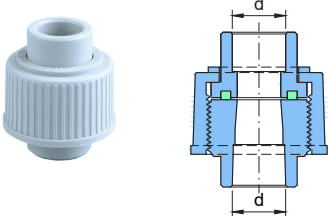
Hollander	Type	D (mm)			Code	SP	LP	kg/pcs
	CW 16x1/2"	16,0			3295440001	10	150	0,025
	20x3/4"	20,0			3295440002	10	150	0,040
	25x1"	25,0			3295441002	5	100	0,063

CW - This product is for cold water only


Detachable joint	Type	D (mm)			Code	SP	LP	kg/pcs
	20	20,0			3295440003	10	100	0,073
	25	25,0			3295441001	10	50	0,119
	32	32,0			3295441003	10	30	0,188
	40	40,0			3295442001	5	20	0,301
	50	50,0			3295442002	2	8	0,800

Europlast with union nut	Type	L [mm]			Code	SP	LP	kg/pcs
	20x3/4"	47,5			3295440507	10	100	0,045

Euroconus MZV (male)	Type	D1 [mm]			Code	SP	LP	kg/pcs
	20x3/4"	35,5			3295410701	10	100	0,045

Direct coupling	Type	d (mm)			Code	SP	LP	kg/pcs
	CW 20	19,5			3295440405	10	50	0,097
	25	24,5			3295441406	10	50	0,088
	32	31,5			3295441417	10	50	0,144


CW - This product is for cold water only

Electrofusion socket	Type	d (mm)	L (mm)	H (mm)		Code	SP	LP	kg/pcs
	20	20,0	70,0	52,0		3295410007	1	1	0,037
	25	25,0	70,0	57,0			1	1	
	32	32,0	80,0	65,0		3295411011	1	1	0,050
	40	40,0	90,0	74,0		3295412001	1	1	0,060
	50	50,0	100,0	85,0		3295412002	1	1	0,080
	63	63,0	111,0	97,0		3295413001	1	1	0,110
	75	75,0	120,0	114,0		3295413002	1	1	0,160
	90	90,0	130,0	130,0		3295413003	1	1	0,350
	110	110,0	140,0	152,0		3295414003	1	1	0,393
	G 125	125,0	151,0	168,0		3295414001	1	1	1,110
	G 160	160,0	172,0	205,0		3295414002	1	1	1,610
	G 200	200,0	203,0	245,0		3295414004	1	1	1,900

G - Green color

Weld in saddle		Type	D (mm)	d (mm)	H (mm)		Code	SP	LP	kg/pcs
		40-50x20	25,0	15,0	29,0		3295412302	1	1	0,024
		63x32	32,0	20,5	27,0		3295413301	1	1	0,040
		75x32	32,0	20,5	27,0		3295413801	1	1	0,040
		90x32	32,0	20,5	27,0		3295413302	1	1	0,040
		110x32	32,0	20,5	25,7		3295414310	1	1	0,047
		110x40	40,0	25,5	25,7		3295414311	1	1	0,052
	G	63-125x20	25,0	15,0	29,0		3295414312	1	1	0,025
	G	63-125 x 25	25,0	15,0	29,0		3295414323	1	1	0,022
	G	63-125 x 32	32,0	20,5	35,0		3295414324	1	1	0,035
	G	75-125 x 40	40,0	25,5	38,0		3295414325	1	1	0,083
	G	90-125 x 50	50,0	32,0	39,0		3295414326	1	1	0,098
	G	110-125 x 63	63,0	40,0	45,0		3295414327	1	1	0,163
	G	160-250 x 20	25,0	15,0	29,0		3295414328	1	1	0,027
	G	160-250 x 25	25,0	15,0	29,0		3295414313	1	1	0,024
	G	160-250 x 32	32,0	20,5	35,0		3295414314	1	1	0,037
	G	160-250 x 40	40,0	25,5	38,0		3295414315	1	1	0,082
	G	160-250 x 50	50,0	32,0	39,0		3295414316	1	1	0,097
	G	160-250 x 63	63,0	40,0	45,0		3295414317	1	1	0,162

G - Green color

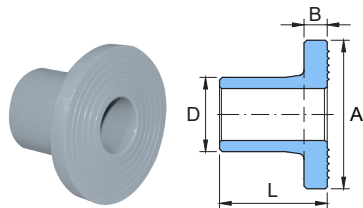
Weld in saddle MZV (male)		Type	D2 (mm)	di (mm)	H (mm)		Code	SP	LP	kg/pcs
		75x3/4"	32,0	20,5	82,3		3295413303	1	1	0,135
		90x3/4"	32,0	20,5	89,8		3295413304	1	1	0,135
	G	63-125x1/2"	25,0	15,0	42,0		3295414340	1	1	0,090
	G	63-125x3/4"	32,0	20,5	49,0		3295414341	1	1	0,130
	G	75-125x1"	40,0	25,5	54,0		3295414342	1	1	0,210
	G	90-125x5/4"	50,0	32,0	59,0		3295414343	1	1	0,340
	G	90-125x6/4"	50,0	34,0	59,0		3295414344	1	1	0,350
	G	110-125x2"	63,0	40,0	68,0		3295414345	1	1	0,650
	G	160-250x1/2"	25,0	15,0	42,0		3295414346	1	1	0,090
	G	160-250x3/4"	32,0	20,5	49,0		3295414347	1	1	0,130
	G	160-250x1"	40,0	25,5	54,0		3295414348	1	1	0,220
	G	160-250x5/4"	50,0	32,0	59,0		3295414349	1	1	0,330
	G	160-250x6/4"	50,0	34,0	59,0		3295414350	1	1	0,350
	G	160-250x2"	63,0	40,0	68,0		3295414351	1	1	0,730

G - Green color

Weld in saddle MZD (female)		Type	D2 (mm)	di (mm)	H (mm)	SW (mm)	Code	SP	LP	kg/pcs
		75x3/4"	32,0	20,5	64,5	51,0	3295413410	1	1	0,091
		90x3/4"	32,0	20,5	72,0	51,0	3295413802	1	1	0,130
	G	63/125 x 1/2"	25,0	15,0	29,0	38	3295414318	1	1	0,007
	G	63-125x3/4"	32,0	20,5	35,0	51	3295414329	1	1	0,110
	G	75-125x1"	40,0	25,5	38,0	63	3295414330	1	1	0,170
	G	90-125x5/4"	50,0	32,0	39,0	70	3295414331	1	1	0,250
	G	90-125x6/4"	50,0	34,0	39,0	70	3295414332	1	1	0,220
	G	110-125x2"	63,0	40,0	45,0	85	3295414333	1	1	0,460
	G	160-250x1/2"	25,0	15,0	29,0	38	3295414334	1	1	0,070
	G	160-250x3/4"	32,0	20,5	35,0	51	3295414335	1	1	0,110
	G	160-250x1"	40,0	25,5	38,0	63	3295414336	1	1	0,170
	G	160-250x5/4"	50,0	32,0	39,0	70	3295414337	1	1	0,240
	G	160-250x6/4"	50,0	34,0	39,0	70	3295414338	1	1	0,240
	G	160-250x2"	63,0	40,0	45,0	85	3295414339	1	1	0,490

G - Green color

Flange adaptor



	Type	D (mm)	L (mm)	d1 (mm)	s (mm)	Code	SP	LP	kg/pcs
	40	40,0	58,0	80,0	12,5	3295412401	1	1	0,078
	50	50,0	60,0	90,0	12,5	3297442608	1	1	0,111
	63	63,0	62,0	105,0	13,5	3297443603	1	1	0,179
	75	75,0	73,0	123,0	14,7	3295413405	1	1	0,275
	90	90,0	92,0	140,0	17,0	3295413406	1	1	0,440
	110	110,0	103,0	160,0	19,0	3295414412	1	1	0,644
G	125	125,0	53,0	162,0	25,0	3295414405	1	1	0,360
G	160	BUTT WELDED				3295414406	1	1	1,610
G	200	BUTT WELDED				3295414407	1	1	3,020

G - Green color

Flange



	Type	d1 (mm)	d2 (mm)	D (mm)	Y (mm)	Code	SP	LP	kg/pcs
	40/DN32	100,0	140,0	46,0	4	3295412402	1	1	1,618
	50/DN40	110,0	150,0	54,0	4	3295412403	1	1	1,811
	63/DN50	125,0	165,0	66,0	4	3295413407	1	1	2,400
	75/DN65	145,0	185,0	83,0	8	3295413408	1	1	2,860
	90/DN80	160,0	200,0	94,0	8	3295413409	1	1	3,520
	110/DN100	180,0	220,0	114,0	8	3295414413	1	1	3,875
G	125/DN100	180,0	220,0	109,0	8	3295414416	1	1	2,120
G	160/DN150	240,0	285,0	160,0	8	3295414415	1	1	2,720
G	200/DN200	295,0	340,0	221,0	8	3295414420	1	1	8,700
G	200/DN200/PN20	295,0	340,0	221,0	12	3295414421	1	1	8,700

G - Green color

Clip



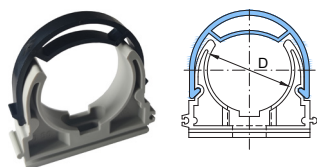
	Type	D (mm)				Code	SP	LP	kg/pcs
	16	16,0				3295410501	50	250	0,007
	20	20,0				3295410507	50	1000	0,003
	25	25,0				3295411509	50	1000	0,004

Double clip




	Type	D (mm)				Code	SP	LP	kg/pcs
	16	16,0				3295410503	20	500	0,009
	20	20,0				3295410506	20	500	0,007
	25	25,0				3295411508	20	300	0,008
	32	32,0				3295411504	1	1	0,034

Clip with clamp



	Type	D (mm)				Code	SP	LP	kg/pcs
	32	32				3295411502	1	1	0,008
	40	40				3295412501	1	1	0,019
	50	50				3295412502	1	1	0,025
	63	63				3295413501	1	1	0,050
	75	75				3295413503	1	1	0,085
	90	90				3295413502	1	1	0,104
	110	110				3295414501	1	1	0,140

Galvanized gutter



	Type	L (mm)				Code	SP	LP	kg/pcs
	20	2000				3295410101	1	25	0,295
	25	2000				3295411101	1	25	0,395
	32	2000				3295411102	1	25	0,445
	40	2000				3295412101	1	25	0,605
	50	2000				3295412102	1	25	0,675
	63	2000				3295413101	1	25	0,870
	75	2000				3295413102	1	25	0,995

VALVES

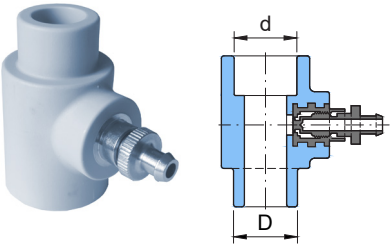
Ball valve - lever	Type	A1 (mm)	L [mm]			Code	SP	LP	kg/pcs
	20	15,5	65,0			3295440408	10	50	0,114
	25	17,0	70,0			3295441409	10	40	0,116
	32	18,0	81,0			3295441422	10	30	0,255
	40	20,5	98,0			3295442402	2	16	0,417
	50	23,5	126,0			3295442409	1	6	0,662
	63	27,5	145,0			3295443402	1	5	1,050
	75	31,0	163,0			3295443406	1	4	1,674

Ball valve - bow tie	Type	A1 (mm)	L [mm]			Code	SP	LP	kg/pcs
	20	15,5	65,0			3295440409	10	40	0,117
	25	17,0	70,0			3295441410	10	40	0,130
	32	18,0	81,0			3295441423	5	20	0,231
	40	20,5	98,0			3295442403	2	10	0,384

Direct valve	Type	A1 (mm)	L [mm]			Code	SP	LP	kg/pcs
	20	14,5	65,0			3295440504	10	50	0,119
	25	16,0	72,0			3295441505	10	40	0,200
	32	18,0	104,0			3295441514	5	10	0,337
	40	20,5	108,0			3295442502	2	8	0,419
	50	23,5	115,0			3295442508	1	4	0,628
	63	27,4	155,0			3295443501	1	4	1,120

Under plaster ball valve direct with chromium cover	Type	A1 (mm)	L [mm]			Code	SP	LP	kg/pcs
	20	14,5	65,0			3295440506	5	20	0,200
	25	16,0	72,0			3295441508	5	20	0,244

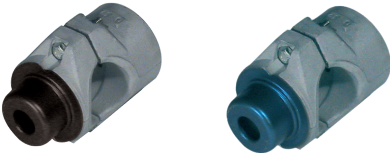
Filter	Type	A1 (mm)	L [mm]			Code	SP	LP	kg/pcs
	25	16,0	85,0			3295441503	2	20	0,144

Pipe coupling with outlet	Type	d (mm)	D (mm)	L [mm]		Code	SP	LP	kg/pcs
	20	19,5	20	59		3295440414	10	100	0,056
	25	24,5	25	59		3295441432	10	100	0,064
	32	31,5	32	61		3295441433	5	50	0,083

L - length, Code - Order code; S - pressure line; SP - Small pack; LP - Large pack; ☎ +420313030914; +420313030916

TOOLS AND ASSEMBLY MATERIALS


Teflon tape	Type	Code	Lenght [m]
	TEFLON	3295490098	12

Jaw adapters black/blue	Type	Code black	Code blue	kg/pcs
	16	3295490004	3295490039	0,099
	20	3295490005	3295490045	0,116
	25	3295490006	3295490040	0,144
	32	3295490007	3295490041	0,220
	40	3295490008	3295490042	0,330
	50	3295490009	3295490043	0,480
	63	3295490010	3295490044	0,770

black - standard quality, blue - increased abrasion resistance

Pair adapters black/blue	Type	Code black	Code blue	kg/pcs
	16			0,084
	20	3295490011	3295490032	0,112
	25	3295490012	3295490033	0,140
	32	3295490013	3295490034	0,190
	40	3295490014	3295490035	0,280
	50	3295490015	3295490036	0,400
	63	3295490016	3295490037	0,740
	75	3295490017	3295490152	1,006
	90	3295490018	3295490038	1,478
	110	3295490019	3295490167	1,950
	125		3295490060	2,658

black - standard quality, blue - increased abrasion resistance

Driller weld in saddle	Type	Code	kg/pcs
	25	3295490134	0,15
	32	3295490135	0,22
	40	3295490136	0,23
	50	3295490137	0,33
	63	3295490138	0,45

Welding tool weld in saddle	Type	Code	kg/pcs
	75-125 x 25	3295490139	0,28
	75-125 x 32	3295490140	0,41
	75-125 x 40	3295490141	0,36
	75-125 x 50	3295490142	0,65
	75-125 x 63	3295490143	1,05
	160-250 x 25	3295490144	0,17
	160-250 x 32	3295490145	0,23
	160-250 x 40	3295490146	0,36
	160-250 x 50	3295490147	0,65
	160-250 x 63	3295490148	1,04

Hand welder POLYS P-1b	Type	Power (W)	Pack	Code	Regulation	Design
	P-1b	500	solo	3295490002	termostat	angle mandrel
			mini	3295490066		

Designed for general use
 Supplied with black adapters only.
 Solo - Hand welder, imbus
 Mini - Hand welder, jaw adapters 20,25,32,40 mm, table clamp, imbus, metal case Mini

Hand welder POLYS P-1a	Type	Power (W)	Pack	Code	Regulation	Design
	P-1a	650	solo	3295490028	termostat	direct mandrel
			mini	3295490050		
			mini plus			

Designed for general use
 Supplied with black adapters only.
 Solo - Hand welder, imbus
 Mini - Hand welder, jaw adapters 20,25,32 mm, table clamp, imbus, metal case Mini
 Mini plus - Hand welder, jaw adapters 20,25,32,40 mm, pipe cutter, table clamp, imbus, metal case Mini

Hand welder POLYS P-1a	Type	Power (W)	Pack	Code	Regulation	Design
	P-1a	850	solo		termostat	knife
			mini			
			mini plus			

Designed for general use
 Supplied with black adapters only.
 Solo - Hand welder, stabilizing stand, imbus
 Mini - Hand welder, jaw adapters 20,25,32 mm, table clamp, imbus, metal case Mini
 Mini plus - Hand welder, jaw adapters 20,25,32,40 mm, stabilizing stand, pipe cutter, table clamp, imbus, metal case Mini

Hand welder POLYS P-4a, P-4b	Type	Power (W)	Pack	Code		Regulation	Design
				black	blue		
	P-4a	650	solo	3295490003		elektronik	direct mandrel
			mini 20-32	3295490051	3295490054		
			mini 20-40	3295490164			
			profi	3295490001	3295490046		
	P-4a tw	650	solo			elektronik	direct mandrel
			mini 20-32				
			mini 20-40				
			profi		3295490056		
	P-4b tw plus	650	solo	3295490057		elektronik	direct mandrel
			mini 20-32				
			mini 20-40				
			profi				

Designed for very frequently use
 Solo - Hand welder, imbus
 Mini - Hand welder, jaw adapters 20-32 mm, stabilizing stand, pipe cutter, imbus, metal case Mini
 Mini - Hand welder, jaw adapters 20-40 mm, stabilizing stand, pipe cutter, imbus, metal case Mini
 Profi - Hand welder, jaw adapters 16-63 mm, welding mirror 100 mm, stabilizing stand, table clamp, pipe cutter, imbus, big metal case Profi

Code - Order code;  +420313030914; +420313030916

Hand welder POLYS P-4a, P-4b	Type	Power (W)	Pack	Code		Regulation	Design
				černá	blue		
	P-4a	850	solo	3295490031		electronic	Knife
			mini	3295490052			
			profi	3295490030	3295490162		
	P-4a tw	850	solo			electronic	Knife
			mini		3295490059		
			profi		3295490055		
	P-4b tw plus	850	solo			electronic	Knife
			mini				
			profi				

Designed for very frequently use

Solo - Hand welder, stabilizing stand, imbus

Mini - Hand welder, jaw adapters 20-32 mm, stabilizing stand, pipe cutter, imbus, metal case Mini

Profi - Hand welder, jaw adapters 16-63 mm, stabilizing stand, table clamp, pipe cutter, imbus, big metal case Profi

Hand welder POLYS P-4a, P-4b	Type	Power (W)	Pack	Code		Regulation	Design
				černá	blue		
	P-4a	1200	solo	3295490149		electronic	Plate
			profi 40-90		3295490133		
			profi 50-110				
			profi 75-125				
	P-4a tw	1200	solo			electronic	Plate
			profi 40-90				
			profi 50-110				
			profi 75-125				
	P-4b tw plus	1200	solo	3295490058		electronic	Plate
			profi 40-90				
			profi 50-110		3295490158		
			profi 75-125				

Designed for very frequently use


Solo - Hand welder, imbus

Profi 40-90 mm, Hand welder, pair adapters, stabilizing stand, table clamp, imbus, big metal case Profi

Profi 50-110 mm, Hand welder, pair adapters, stabilizing stand, table clamp, imbus, big metal case Profi

Profi 75-125 mm, Hand welder, pair adapters, stabilizing stand, table clamp, imbus, big metal case Profi

Electrofusion maschine for electrofusion socket	Type	Power (W)	Code
	SVEL 950	950	
	SVEL 3500	3800	
	SVEL 3500 PLUS	3800	

Socket welding maschine	Type	Hand welder	Inserts	Code
	MP 75	-	40-75	
	MP 110 UM	P-4a 1250	40-110	3295490053
	MP 110 UD	P-4a 1250	40-110	3295490024
	MP 110 UD EKO	P-4a 1250	63-110	

Montage maschine of preparation	Type	Code	kg/pcs
	MP - 75		22,000

Pipe cutter	Type	D (mm)	Code	kg/pcs
	Dyno 42	42		0,350





At the end of the service life of the product, the company must obtain the appropriate authorization.

Our technical advice consists of knowledge of standards, calculations and previous experience. We do not have the opportunity to influence the conditions of use of the products we offer, especially non-standard handling of products or use or installation, therefore all data stated in our catalog are non-binding.

Warranties apply to the quality parameters of our products and goods. In the event of damage, our liability applies to the value of the goods delivered by us.

We reserve the right to deliver goods other than those shown in the catalog. Use our order numbers in your orders.

We regularly update the catalogs and brochures and reserve the right to change the information contained therein.

Therefore, always check the up-to-dateness of a specific catalog or prospectus at www.pipelife.cz.

Pipelife Czech s.r.o.

Kučovaniny 1778
765 02 Otrokovice
tel.: +420 577 111 213

www.pipelife.cz

Pipelife Slovakia s.r.o.

Kuzmányho 13
921 01 Piešťany
tel.: +421 337 627 173

www.pipelife.sk

PIPELIFE 
always part of your life